

**Carlsbad Fire Department  
Fire & Life Safety Division**

**Guideline for  
Fire Department Access and  
Water Requirements for  
Commercial and Residential Development**



Approved and Authorized by:  
Randall Metz, Fire Marshal  
Issued: August 4, 2023

# **Table of Contents**

PURPOSE.....	3
SCOPE.....	3
SUBMITTAL REQUIREMENTS.....	5
1. Plan Submittal General Requirements .....	5
2. Fire Access Roadway Specifications .....	6
3. Fire Access Roadway Identification.....	10
4. Premises Identification.....	11
5. Obstructions to Emergency Vehicle Access .....	13
6. Requirements for Residential Tract Developments.....	15
7. Engineered Alternative Fire Apparatus Access Systems .....	17
8. Hydrant and Water Availability Requirements .....	18
9. Access to Structures.....	22
10. Access during construction.....	25
INDEX OF ATTACHMENTS .....	30

# **Guideline for Fire Department Access & Water Requirements for Commercial and Residential Development**

## **PURPOSE**

This document is a general guideline pertaining to the creation and maintenance of fire department access roadways, access walkways to and around buildings, and hydrant quantity and placement as required by the 2022 California Fire and Building Codes (CFC and CBC) and as amended by the State of California, and locally adopted ordinances enforced by the city of Carlsbad, Office of the Fire Marshal (CFD).

## **SCOPE**

These guidelines apply to new, remodeled, reconstructed, or relocated residential or commercial structures and developments to which emergency response may be necessary. The information contained in this document is intended to assist the applicant in attaining compliance and to ensure that privately owned roadways necessary for emergency response purposes will be available for use at all times. This guideline includes requirements for:

1. Plan submittal General Requirements
2. Fire access roadway design
3. Fire access roadway identification
4. Premises identification
5. Obstructions to Emergency Vehicle Access
6. Requirements for Residential Tract Developments
7. Engineered Alternative Fire Apparatus Access Systems
8. Hydrant and Water Availability Requirements
9. Access to structures
10. Access during construction

The following definitions are provided to facilitate the consistent application of this guideline:

- A. *Access Walkways* - An approved walking surface leading from fire access roadways to exterior doors, the area beneath rescue windows, and other required openings in structures.
- B. *Bollards* - Permanent or removable poles that are placed across a roadway for restricting vehicular access to a portion of a site or to protect a piece of equipment from potential vehicular damage. Bollards are not permitted across a fire access roadway.
- C. *Fire Apparatus Access Roads* - The means for emergency apparatus to access a facility or structure for emergency purposes. Roadways must extend to within 150 feet of all portions of the exterior of the first floor of any structure and must meet specified criteria for width, pavement characteristics, roadway gradient, turning radius, etc. Fire apparatus access roads are also referred to as fire lanes.
- D. *Fire Lane Identification* – Signs or curb markings that allow fire apparatus access roads to be readily recognized so that they will remain unobstructed and available for emergency use at all times.
- E. *Gates and Barriers* - Devices that restrict pedestrian and vehicle ingress and egress to and from a facility.
- F. *Gate and Barrier Locks* - Devices that are installed on gates and barriers to secure a property or facility.
- G. *Hose Pull* – The effective distance (150 feet) that firefighters can drag a hose from fire apparatus to attack a fire. Hose pull is measured along a simulated path of travel accounting for obstructions and not “as the crow flies.” See Attachments 29 and 30.
- H. *Premises Identification* - The visual means (address numbers) used to readily identify a property or facility street address. It may also be used to distinguish separate buildings within a single facility or property.
- I. *Rescue Openings* – Exterior doors or windows required in all sleeping rooms in R occupancies located below the fourth story of a building that allow rescue of trapped occupants.
- J. *Very High Fire Hazard Severity Zone (VHFHSZ)* – A designated area in which the type and condition of vegetation, topography, fire history, and other relevant factors increase the possibility of uncontrollable wildland fire. Structures within a VHFHSZ require special construction features to protect against wildfire hazards; please consult with the building department and refer to CBC Chapter 7A for specific requirements.

## **SUBMITTAL REQUIREMENTS**

Plans shall be provided to demonstrate compliance with all codes and other regulations governing water availability for firefighting and emergency access to sites and structures within the City of Carlsbad. In addition, changes to existing structures or sites shall be reviewed by the City of Carlsbad to ensure that the modifications do not affect water availability or access.

### **1. Plan Submittal General Requirements**

- A. Three plan sets will need to be submitted to the City of Carlsbad Building Department. The Carlsbad plan review and inspection fees are due upon submittal of the plans.
- B. The scope of work shall be clearly indicated on the plan. If the building or site in question was approved previously, include the Carlsbad permit number of that prior approval on the new plans. A copy of the previously approved fire master plan shall be submitted along with new plan sets for any revision.
- C. Information related to the building's location, use, and construction shall be clearly indicated on the plan.
  - 1) Include the project's street address (or a working address of the job trailer or future building on the site when not known) and the tract, tentative tract, or parcel map number (this is NOT the County Assessor's parcel number or APN).
  - 2) Indicate the types of occupancies that will be housed in the structure as listed in California Building Code (CBC) Chapter 3.
  - 3) Indicate the construction type of each building and whether footnote 'd' from Table 601 is being applied for a 1-hour construction type equivalency.
  - 4) Indicate the building height on the plans as defined in CBC. If the building height is greater than 50 feet, also indicate the elevation change (measured from finished floor to finished floor) between the lowest floor giving access to the structure and the highest occupied floor or occupied roof deck.
  - 5) Note the type of sprinkler system installed/proposed (e.g., NFPA 13, 13-R, or 13-D).
  - 6) For structures, larger than 6,000 square feet, provide an allowable area calculation (and a mixed occupancy calculation, if the building houses multiple occupancies) to demonstrate that the building can be of the specified size and construction type.

- D. Water Availability – To facilitate the review process and avoid untimely delays in project approval, applicants are strongly encouraged to arrange a hydrant flow test with the water company prior to submitting plans to the City of Carlsbad if the project includes a new structure or increase in the floor area of an existing structure. Water availability information may not be required to be submitted for every project, and plans may be submitted with a hydrant flow test pending, but the applicant should understand that project approval may be delayed if it is determined during review that this information is required. If the project requires evaluation of the available fire flow, it will not be approved without a completed Carlsbad Water Availability form or equivalent data sheets from a water district. Water availability information must be no older than six months.
  
- E. Conditions of Approval – To ensure consistency of the fire access plan with project conditions, include any conditions of approval pertaining to the review of the project on the plans. If the project does not require review and entitlement by the Planning Commission, City Council, or the planning department permit review process is required but has not yet been completed, please state this on the plan. If you are unsure whether your project requires planning approval, please contact the planning department.
  
- F. Complete Attachment 2, Fire Master Plan Submittal Checklist, and verify that basic project information has been provided and that general access and water requirements have been addressed on the plan.
  
- G. Required Plan Notes – Include the Carlsbad Fire Department Access & Water Notes on the plan. See Attachment 1.

## **2. Fire Access Roadway Specifications**

Fire access roadways, commonly referred to as fire lanes, shall be provided for every facility or building when any portion of an exterior wall of the first story is located more than 150 feet from a public roadway, as measured along an approved route. Extenuating circumstances, increased hazards, and additional fire safety features may affect these requirements.

- A. Fire Apparatus Access Road Design - Fire access roadways must be engineered to support emergency response apparatus. Roadways must be designed to facilitate turning radii of apparatus and meet requirements for gradient, height clearance, and width. Specific criteria pertaining to the design of fire access roadways are detailed below.

1) Fire access roadways shall be designed, constructed, and maintained to support the imposed loads of Carlsbad fire apparatus with a total weight of 72,000 pounds. Apparatus weight is distributed as 46,000 pounds on tandem rear axles and 22,000 pounds on the front axle. The surface shall be designed, constructed, and maintained to provide all-weather driving capabilities. A letter or statement, wet-stamped and signed by a registered engineer, shall be provided on the plans certifying that any new roadway meets this 72,000-pound, all-weather requirement. Road base without an appropriate topping or binding material does not satisfy the all-weather requirement.

2) Number of Fire Apparatus Access Roads Required:

a) One is required if any portion of an exterior wall of the first story of a building is located more than 150 feet from a fire access roadway. That access is to be measured by an approved route around the exterior of the building (see Section 9: Access to Structures).

b) More than one road is required if it is determined that access by a single road may be insufficient due to terrain, location, travel distance, potential fire or life-safety hazards, or other factors that could limit access or if vehicle congestion, railways, or weather conditions could impair the single-entry point. Supplementary access points shall be located to facilitate evacuation and emergency operations and minimize congestion or obstruction during an emergency incident.

i. A minimum of two vehicle access points is required for any development containing 150 or more residential units.

ii. A secondary access point may also be required for commercial projects more than 124,000 sq.ft. in building area. Requirements may vary depending on factors such as building use, expected vehicle and occupant load on site, traffic stacking, or impact on surrounding streets.

c) Developments of one- or two-family dwellings where the number of dwelling units exceeds 40 shall be provided with two separate and approved fire apparatus access roads.

3) Location of Fire Apparatus Access Roads:

For purposes of determining the suitability of public roads and fire access roadways for staging fire apparatus and facilitating fire suppression operations for a particular structure, the following criteria shall apply:

- a) To protect fire apparatus, personnel, and equipment from damage and injury from falling debris, the edge of fire access roadways serving multi-story buildings should be located no closer than 10 to 30 feet from the building, the actual distance being a function of overall building height with consideration given to building construction, presence of openings, and other potential hazards. As distances greater than 40 feet inhibit the use of vehicle-mounted ladders while distances closer than 20 feet do not allow for a proper laddering angle, the edge of fire lanes serving structures four or more stories in height shall be located between 20 and 40 feet from the building. These distances are measured from the face of the building to the top edge of the curb face or rolled curb flow line nearest the structure. To ensure that vehicular access and egress from dead-end fire access roadways serving multi-story buildings are maintained at all times, staging areas shall be provided along the roadway to permit fire apparatus to pass ladder trucks that have outriggers extended. Consideration shall be given to the length of the roadway, roof and building design, obstructions to laddering, and other operational factors in determining the number, location, and configuration of such staging areas.
  - b) Access may be taken from an on-site fire apparatus access road or from a public road with an average daily trip (ADT) count below 30,000 unless a recorded access easement agreement is in effect to obtain access from adjacent properties. Contact the city Traffic Engineer's Office or Public Works Department for ADT information.
  - c) Public roads with an ADT count of 30,000 or more may be acceptable as a fire department access point serving an adjacent site when certain conditions and features (e.g., vehicle turnouts, acceleration/deceleration lanes) are present that limit the hazard to firefighters and other drivers. Such access roads will be evaluated on a case-by-case basis.
- 4) Width of Fire Access Roads - The minimum width of a fire access roadway is 24 feet. If a center median is included, the required width shall be provided on both sides of the median. Except: Private driveways used as required fire apparatus access roads serving no more than two dwellings shall have a minimum width of 16 feet.

In designated Fire Hazard Zones/Fire Suppression Zones, fire lanes shall be at least 28 feet wide; Exception: fire lanes that are 150 feet or less in length may be 24 feet wide if serving one to three dwelling units. This width shall be provided to a logical termination outside of the VHFHSZ. Refer to the



FHSZ maps or contact the Carlsbad Planning and Development Services Section to determine whether your project is located within a FHSZ/Fire Suppression Zone.

The width of fire department access roads is measured from top face of the curb to top face of the curb on streets with standard vertical curbs and gutters, and from flow line to flow line on streets with rolled, sloped, flared, or other non-vertical curb and gutter configurations. Flow line is the lowest continuous elevation on a curb. Road sections and curb details or approved city street improvement plans may be required to verify method of measurement.

5) Aerial Fire Apparatus Access Roads:

The minimum of an aerial fire apparatus access roadway is 26 feet, exclusive of shoulders.

The aerial access road must be a minimum of 15 feet and a maximum of 30 feet from the building and shall be positioned parallel to one entire side of the building.

No overhead utility and power lines shall be located over the aerial fire apparatus obstructions. Other obstructions shall be permitted to be placed with the approval of the fire code official.

6) Parking Restrictions - No parking is permitted on roadways that are narrower than 28 feet in width. Parking on one side is permitted on a roadway that is at least 28 feet but less than 36 feet in width. Parking on two sides is permitted on a roadway 36 feet or more in width. These restrictions apply to all roads serving as fire lanes, including those located in VHFHSZ. See Attachment 3. Note: Minimum street widths for allowed parking may be more restrictive in some cities. Check with the Planning Department for specific requirements.

7) Vertical Clearance - Fire access roads shall have an unobstructed vertical clearance of not less than 13 feet 6 inches. If trees are located adjacent to the fire access roadway, place a note on the plans stating that all vegetation overhanging the fire access roadway shall be maintained to provide a clear height of 13 feet 6 inches at all times. See Attachments 4 and 5.

8) Fire Apparatus Access Road Grade - The grade for access roads shall not exceed 10% or 5.7 degrees. The grade may be increased to a maximum of 15% or 8.5 degrees for approved lengths of access roadways, when all structures served by the access road are protected by automatic fire

sprinkler systems. Cross-slope shall not be greater than 2% for paved access roadways.

- 9) Inside and Outside Turning Radii - The inside turning radius for an access road shall be 17 feet or greater. The outside turning radius for an access road shall be 38 feet or greater. As fire apparatus are unable to negotiate tight "S" curves, a 56-foot straight leg must be provided between these types of compound turns or the radii and/or road width must be increased accordingly. See Attachment 6. Note: to accommodate the Carlsbad' largest fire apparatus an inside and outside turning radius of 20 and 42 feet, respectively, is recommended and requested.
- 10) Dead-end Access Roadways - Dead-end roadways in excess of 150 feet shall be designed and constructed with approved turnarounds or hammerheads. Turnarounds shall meet the turning radius requirements identified above. The minimum cul-de-sac radius is 38 feet with no parking allowed. The maximum length of a cul-de-sac road without mid-way turnarounds or other mitigating features is 800 feet. See Attachment 7. Note: to accommodate the Carlsbad's largest fire apparatus, an outside turning radius of 42 feet or larger is recommended and requested.
- 11) Bridges - When a bridge is required as part of an access road, it shall be a minimum of 20' in width and designed and constructed to accommodate a total weight of 68,000 pounds. Apparatus weight is distributed as 46,000 pounds on tandem rear axles and 22,000 pounds on the front axle.
- 12) Median breaks - Where medians or raised islands are proposed that prevent emergency apparatus from crossing over into opposing traffic lanes, breaks or pass-throughs may be required to be provided. The location and design specifications for the pass-through shall be coordinated with the city public works or engineering department.

### **3. Fire Access Roadway Identification**

Fire lane identification will be required when it is necessary to restrict parking of vehicles in order to maintain the required width of fire access roadways for emergency vehicle use. Unlawful use of fire lanes will be enforced by the local law enforcement agency in accordance with the California Vehicle Code. See Attachment 8.

- A. Sign and Curb Marking Options - Areas designated as a fire lane require an acceptable method of marking that shall be approved prior to installation. Examples of dimensions and acceptable options for signage installations and markings are

found in Attachments 9 through 14. The following methods are acceptable means of identifying designated fire lanes for public and private streets. Choose either option 1 OR option 2 below.

- 1) Specific areas designated by the Carlsbad as fire lanes must be marked with red curbs meeting the specifications in Attachment 9. In addition, where the number of entrances into the area marked with fire lanes is limited, all such vehicle entrances to the designated area shall be posted with approved fire lane entrance signs meeting the specifications in Attachment 10.
- 2) “Fire Lane—No Parking” signs meeting the specifications in Attachment 11 shall be posted immediately adjacent to each designated fire lane and at intervals not to exceed 50 feet. See Attachment 12. In addition, where the number of entrances into the area marked with fire lanes is limited, all such vehicle entrances to the designated area shall be posted with approved fire lane entrance signs.

Note: All alternative signs must be approved through the City of Carlsbad and by the city engineer and/or police agency, as applicable.

#### **4. Premises Identification**

Three possible configurations of buildings or units within a building may exist and are identified as follows: freestanding buildings, multi-unit buildings, or multi-building clusters. Common to all configurations are the following requirements:

- A. Approved numbers or addresses shall be placed on the front elevation of all new or existing buildings in such a position that is plainly visible and legible from the street or road on which the property is addressed. Addresses shall not be located where they have the potential of being obstructed by signs, awnings, vegetation, or other building/site elements. An address monument at the vehicle entrance or other location clearly visible and legible from the public road may be provided in lieu of an address on the structure where only a single building with a single street address is present and no other structures are accessible from the fire lane serving that structure.
- B. The numbers shall contrast with their background.
- C. The numbers shall be a minimum of 4 inches or more in height with a ½” stroke for single-family residential structures/duplexes, 6 inches or more with a ½” stroke for individual unit numbers in multi-family residential structures, and 12 inches or more

with 1.5" stroke for commercial structures or the primary building address or address range posted on multi-family residential structures.

D. Building setbacks, elevation, and landscaping can affect these minimum size requirements. Additional numbers shall be required where deemed necessary by the Fire Code Official, such as rear access doors, building corners, secondary access roadways and entrances to commercial centers. The Fire Code Official may establish different minimum sizes for numbers for various categories of projects

E. Numbers for new buildings shall be illuminated to be visible at night.

F. Where it is unclear as to which street a building is addressed to (e.g., a building is accessed only from a street other than the one it is addressed to; multiple main entrances to the site or building itself front different streets), the name of the street shall also be identified as part of the posted address.

In addition to common requirements specified above, the following additional requirements pertain to each building configuration:

- 1) Multi-Unit Buildings - Suite/apartment numbers shall be placed on or adjacent to the primary entrance for each suite/apartment and any other door providing access to fire department personnel during an emergency. Multiple residential and commercial units having entrance doors not visible from the street or road shall, in addition, have approved numbers grouped for all units within each structure and positioned to be plainly visible from the street or road.
- 2) Multi-Building Clusters - Approved numbers or addresses shall be placed on the front elevation(s) of all buildings that form the cluster. If all building addresses are not clearly visible or legible from the public road serving the structures, an address monument shall also be provided at the entry point(s) to the site indicating the range of addresses accessible from that entrance.

G. Premise identification requirements per Carlsbad Municipal Code section 505.3:

- 1) All easements which are not named differently from the roadway, from which they originate, shall have an address sign installed and maintained, listing all street numbers occurring on that easement, located where the easement intersects the named roadway. Minimum size of numbers on that sign shall be four inches in height with a minimum stroke of 3/8" and shall contrast with the background.

H. Premise identification requirements per Carlsbad Municipal Code section 505.4:

- 1) A lighted directory map, meeting current fire department standards, shall be installed at each driveway entrance to multiple unit residential projects and mobile home parks, where the number of units in such project exceeds 15.

## **5. Obstructions to Emergency Vehicle Access**

Existing or proposed gates and barriers crossing fire apparatus access roadways must be shown on the plans. Information such as the location, type of gate (e.g., swinging, sliding), dimensions, and method of operation (manual, electric) must also be provided. Note or identify the following on the fire master plan:

- A. Clear Width – Gated openings for egress and ingress of vehicles shall not be less than 13 feet clear width. The vertical clearance shall not be less than 13 feet 6 inches, including landscaping and/or trees. This reduction in width is applicable only to the area immediately adjacent to the guard house or gate. Roads leading up to and beyond the guard house or gate shall meet standard fire lane width requirements prescribed in Section 2.A.4 of this guideline. See Attachment 4.
- B. Turning Radii - The minimum inside turning radius is 17 feet with an outside radius of 38 feet for both the exterior and the interior approach to the gate. To accommodate the Carlsbad's largest fire apparatus, 20 feet and 42 feet or larger for inside and outside turning radii, respectively, is recommended and requested where possible.
- C. Setbacks from the Street - Gates and barriers shall be located a minimum of 46 feet (for existing developments) and 56 feet (for new developments) from any major street. A private driveway serving only one single-family residence is exempt from this requirement. If existing conditions prevent installation of the minimum setback, documentation supporting an acceptable alternative shall be provided. The alternative solution must facilitate emergency ingress without endangering emergency response personnel, emergency apparatus, and the general public. The alternative shall be subject to review and approval. See Attachment 15.
- D. Setbacks from First Interior Turn - A 27-foot minimum unobstructed setback is required from a gate to the first turn to allow emergency apparatus clearance. See Attachment 15.
- E. Manually Operated Gate and Barrier Design - Typical gate designs may include sliding gates, swinging gates or arms, or guard posts with a chain traversing the opening.
  - 1) Permanent or removable bollards are not permitted to be placed across fire access roadways.

- 2) For gates and barriers that are not used on a frequent basis or those that are located such that they have a reasonable likelihood of being blocked by vehicles, vegetation, furniture, or other obstructions (e.g., secondary fire department vehicle ingress/egress points, gates accessed from plazas or turf block areas), permanent signage constructed of 18-gauge steel or equivalent shall be attached on each face of the gate or barrier that reads "FIRE LANE—NO PARKING." See Attachment 16 for an example of a barrier sign.
- 3) Manually operated gates and barriers shall have frangible padlocks, Knox padlocks, or weather-resistant Knox key boxes. The key box shall be placed four to five feet above the roadway surface at the right side of the access gate in a conspicuous location that is readily visible and accessible. The key box must be clearly labeled "FIRE DEPT."

F. Electrically Operated Gates and Barriers.

- 1) In the event of loss of normal power to the gate operating mechanism, it shall be automatically transferred to a fail-safe mode allowing the gate to be pushed open by a single firefighter without any other actions, knowledge, or manipulation of the operating mechanism being necessary and without the use of battery back-up power; this shall be noted on the plan. The manufacturer's specification sheet demonstrating compliance with this method of operation during power loss shall be provided or scanned directly onto the plan. Should the gate be too large or heavy for a single firefighter to open manually, a secondary source of power by means of an emergency generator or a capacitor with enough reserve to automatically and immediately open the gate upon loss of primary power shall be provided.
- 2) The gate control for electronic gates shall be operable by a Knox emergency override key switch (with dust cover). The key switch shall be placed between 42" and 48" above the roadway surface at the right side of the access gate within two feet of the edge of the roadway. The key switch shall be readily visible and unobstructed from the fire lane leading to the gate. The key switch shall be clearly labeled "FIRE DEPT."
- 3) Upon activation of the key switch, the gate shall open and remain open until returned to normal operation by means of the key switch. Where a gate consists of two leaves, the key switch shall open both simultaneously if operation of a single leaf on the ingress side does not provide for the width, turning radii, or setbacks necessary for fire apparatus to navigate the vehicle entry point. Note this requirement on the plan.

- 4) The key switch shall be labeled with a permanent red sign with not less than ½" contrasting letters reading "FIRE DEPT" or with a "Knox" decal. Note this requirement on the plan.
- 5) Gate and Barrier Locks - Gate or barrier locks shall be reviewed and approved prior to their installation on any new and/or existing access gate or barrier.

## 6. Requirements for Residential Tract Developments

The following requirements apply to all new residential tract developments with single-family homes or duplexes. They may also be applied to individual single-family homes or duplexes or to multi-family housing projects as approved by the fire code official.

### A. Cul-de-sacs. See Attachment 17.

- 1) Any street that is a required fire lane and greater than 150 feet in length shall be provided with a 38-foot minimum turning radius or other approved turnaround within 150' of the end of the fire lane. See Attachment 17.
- 2) The cul-de-sac "bulb" (the portion at the end of the cul-de-sac street which is wider than the cul-de-sac "neck" leading to it) shall be identified as a fire lane with red curbs or "Fire Lane—No Parking" signs. Fire lane markings may be omitted from the bulb if one or more of the following applies:
  - a) A three-point turn may be made within 150' of the end of the cul-de-sac with all areas along the curb assumed to be occupied by parked vehicles. Auto-Turn software or other approved methods shall be used to demonstrate this. See Attachment 7; or
  - b) The length of the cul-de-sac street, including any driveway or spur road accessed from the bulb that is a required fire lane, is not more than 150 feet; or
  - c) The radius of the cul-de-sac is at least 46 feet; or
  - d) The cul-de-sac is a public street and local traffic or planning restrictions prohibit the designation of fire lanes in the bulb:
    - i. Written concurrence shall be provided from the city traffic engineer indicating that such a prohibition on fire lane signs or

red curbs is consistent with local zoning, development, and traffic codes.

- 3) Cul-de-sacs longer than 150 feet that are required to be designated as fire lanes may contain a center island provided that:
  - a) A minimum 28-foot-wide drive lane with an adequate inside turning radius is provided around the island, and
  - b) Island landscaping will not intrude into the drive lane, and
  - c) The island is designated a no parking area with red curbs or fire lane signs. See Attachments 18 and 19.
- 4) Cul-de-sac streets that are not required fire lanes as determined by the Fire Marshal are exempt from fire lane identification, turnaround, and other standard requirements. See Attachment 20.

B. Residential eyebrow roads. See Attachment 21.

- 1) If the “eyebrow” does not meet Carlsbad’s turning radius and minimum width, fire department access will be measured around the island and any other obstructions from the nearest available fire lane.

C. When a detached single-family home or duplex, or related accessory structure (poolhouse, casita, garage, workshop, barn, etc.) on a single-family residential lot, is protected throughout by an approved NFPA 13-D, 13-R, or 13 fire sprinkler system, access distance as measured along an approved route from the fire apparatus to the main entry door serving the interior of the structure may be up to 300 feet. Enhancements to the sprinkler system or project may be required when this distance exceeds 300 feet or when otherwise necessary to mitigate deficiencies in water supply, hydrant location, inaccessible portions of the building’s perimeter, location in a cul-de-sac with an island, etc.

D. Since local law enforcement resources are limited for enforcement purposes in private developments, the City of Carlsbad requires a viable parking enforcement plan from the developer prior to approving the fire department access & water plan. Parking enforcement plans shall include:

- 1) Detailed information specifically identifying who will be responsible for enforcing the plan, and



- 2) Powers granted to the entity shall include vehicle towing for parking violations (include language similar to that provided in Attachment 8 of this guideline), and
- 3) The level of enforcement to be carried out within the development.

This information must be integrated into the fire master plan. Evidence that the enforcement plan is permanently incorporated into the Conditions, Covenants, and Restrictions (CCRs) and/or recorded against the deed shall be provided prior to Carlsbad approval of the final map or print of linen. Once approved, these provisions cannot be amended without written approval by the, City of Carlsbad. See Attachment 22 for a sample enforcement letter.

## **7. Engineered Alternative Fire Apparatus Access Systems**

The following criteria will be used when evaluating an alternative engineered access surface material for a specific application (e.g., "Turf block," "Grasscrete"). Prior to installation, the design professional must incorporate these criteria into a plan submittal subject to approval by, City of Carlsbad, which reserves the right to limit the amount or extent of alternative surface serving as required fire department access to a structure or site.

- A. Calculations and a statement stamped and signed by a registered civil engineer or other qualified registered professional shall certify that the proposed surface and substrate meets the criteria of an all-weather driving surface and is capable of withstanding the minimum weight of 72,000 pounds imposed by Carlsbad fire apparatus. *Note: Carlsbad recommends a minimum weight capability of 72,000 pounds in order to support our largest apparatus.*
- B. Manufacturer's specification of the material being installed must indicate that the application is consistent with the manufacturer's recommendations.
- C. Material shall only be installed on slopes of no more than one degree (1.75% grade), unless otherwise specified by the manufacturer, and drainage shall be provided as required to provide adequate traction for the fire apparatus. Surfaces shall be crowned or sloped to one side to drain water away from the roadway; surfaces shall not have a "V" or other configuration causing water to accumulate in the fire access roadway. This information shall be detailed on the plan.
- D. The design shall include a curb cut that delineates entry onto the engineered fire access surface from a street. A 4" or lower curb cut or a rolled/ramped curb is acceptable. The curb cut must be shown on the plan. The entry to the area shall be

clearly marked as a fire lane with either a red curb or sign to prevent the entry from being blocked.

- E. A minimum four-inch wide concrete strip around the perimeter of the designated area shall be specified on the plan to clearly delineate the extent of fire department access. If the area is accessible to or intended to be used by anyone other than emergency responders, the concrete curb shall be painted red and stenciled “Fire Lane—No Parking” in white every 30 feet or portion thereof. In areas where painting the curb is not feasible, alternative methods of delineating the extent of the fire access roadway, such as by stamping “Fire Lane—No Parking” into the concrete, posting of signs, or by the use of red reflectors, may be acceptable if approved by Carlsbad plan review staff. Describe the method of identifying the extent of the fire access roadway clearly on the plan.
- F. The following sentence shall be placed, verbatim, as a note on the plan: “Final approval is subject to actual field acceptance testing utilizing Carlsbad fire apparatus.”
- G. A clause requiring the maintenance of alternative access roadways shall be placed in the CCRs, deed, and/or similar documents.

## **8. Hydrant and Water Availability Requirements**

Applicants must provide documentation that hydrants are provided in the quantity and spacing described in California Fire Code (CFC) Appendix C. This will prove that they are capable of delivering the amount of water required by CFC Appendix B. The quantity and spacing of hydrants are governed by the fire flow required for the structure(s) served. The required fire flow is dependent upon the size of the structure, type of construction, and whether the building is equipped with fire sprinklers. This information must be shown clearly on the plans to assist in the determination of the fire flow requirement.

- A. Water Availability – To facilitate the review process and avoid untimely delays in project approval, applicants are strongly encouraged to arrange a hydrant flow test with the water company *prior to submitting plans to the Carlsbad* if the project includes a new structure or increase in the floor area of an existing structure. Water availability information may not be required to be submitted for every project, and plans may be submitted with a hydrant flow test pending, but the applicant should understand that project approval may be delayed if it is determined during review that this information is required. If the project requires evaluation of the available fire flow, it will not be approved without a completed Carlsbad Water Availability form or equivalent data sheets from a water district. Water availability information must be no older than six months.

- 1) Obtain a Water Availability form from Carlsbad Building Department.

- 2) Fill out the project and building information in the first section of the Water Availability form. Care should be taken when determining the applicable fire area for the project. As stated above, fire flow is dependent on several factors, so *the largest building or group of structures is not necessarily the most demanding* in terms of fire flow.
  - 3) Determine the required fire flow from CFC Table B105.1, provided in Attachment 23. A **maximum 50%** reduction in fire flow (but not duration) may be taken when the fire-flow calculation area consists only of buildings equipped with an approved automatic fire sprinkler system.
  - 4) Contact the local water company to request a hydrant flow test or fire flow modeling calculation and have a representative of the water company complete and sign the last section on the form. In some cases, the water company may allow or require a qualified third party to perform the flow test for you.
    - a) In newly developed areas without water infrastructure, the water department may issue a “will-serve” letter indicating the expected amount of water that will be delivered once the water system is installed and operational.
    - b) If multiple hydrants are located within the maximum distance allowed by CFC Table C105.1, the amount of water available from each hydrant may be combined, provided that the hydrants are flowed simultaneously.
    - c) It is the applicant’s responsibility to ensure that the following information is provided at a minimum on either the water company’s test data sheet and/or the Carlsbad Water Availability form:
      - i. Static pressure and residual pressure in psi and observed flow in gpm; or
      - ii. Calculated flow in gpm at 20 psi.
    - d) Scan or photocopy the completed form or data sheets onto your plans or include the original with your plan submittal.
  - 5) Please ensure that the fire area, building size, construction type, and flow data are complete and accurate. Errors or omissions in this information may result in plans having to be resubmitted or fire flow testing being redone.
- B. Fire-Flow Calculation Area – The fire-flow calculation area shall be the total floor area of all floor levels within the exterior walls, and under the horizontal projections of the

roof of a building, except as modified in Section B104.3. Portions of buildings which are separated by fire walls without openings, constructed in accordance with the California Building Code are allowed to be considered as separate fire-flow calculation areas. The fire-flow calculation area of buildings constructed of Type IA and Type IB construction shall be the area of the three largest successive floors. CFC Appendix B Section B104.

- C. Hydrant Location – Hydrants shall be provided along the length of the fire access roadway in the quantities and up to the maximum distances prescribed in CFC Table C-105.1. See Attachments 26 and 30.
- 1) Hydrants must be located no more than three feet from the edge of a fire access roadway and cannot be located in areas where they will be visually or operationally obstructed (behind fences or walls, in bushes, behind parking spaces, etc.). Clearance shall be provided to a distance no less than three feet from the perimeter of the hydrant. Where hydrants are located in landscaped areas, a 4x4' concrete pad shall be required to ensure that vegetation does not encroach on this clear space.
  - 2) The hydrant outlets must face the fire access roadway. Where all of the outlets cannot face the fire access roadway (e.g., the hydrant is located in a landscape peninsula or island in a parking lot; the hydrant has three outlets), the 4" outlet(s) shall take precedence.
  - 3) The hydrant shall be located at least 40 feet from the building(s) it serves. Where it is impractical to locate the hydrant 40 feet from adjacent structures, additional hydrants may be provided or the hydrant may be located closer provided that nearby walls do not contain openings and the hydrant is not otherwise located where it can be rendered inoperable due to damage from collapsed walls, debris, or excessive heat.
  - 4) Hydrants shall be located so that a hose line running between the hydrant and the fire department connection(s) (FDCs) served by that hydrant does not cross driveways, obstruct roads or fire lanes, or otherwise interfere with emergency vehicle response and evacuation of a site.
  - 5) Hydrants and fire department connections shall not be located behind parking stalls or in other locations where they are likely to be blocked by vehicles or other objects. Whenever possible, hydrants shall be placed at street and drive aisle intersections in preference to mid-block locations. Where on-street parking is allowed, hydrants should be placed in the shortest parkways between adjacent driveways, at corners and chokers where parking is not

normally allowed, and in similar areas where impact to space available for parking and the potential for hydrants to be obstructed is minimized.

- 6) Hydrants and fire department connections should not be located where apparatus staged at these appurtenances would then encroach on minimum fire apparatus turning radii unless alternative routes are available. Hydrants shall not be placed in the “bulb” end of a cul-de-sac where apparatus staged at the hydrant would prevent the cul-de-sac from being used as a turnaround.

D. Protection of Hydrants – Where hydrants are located such that they are exposed to potential damage from vehicular collision, they shall be protected by curbs or bollards. See Attachment 27.

- 1) If vehicles can approach the hydrant from more than one direction, the hydrant shall be protected by four bollards of concrete-filled pipe four inches in diameter and mounted in concrete in a square around the hydrant. The bollards need to be spaced a minimum of three feet from the perimeter of the hydrant. The bollards must be placed so that their location does not impede access to or use of the hydrant. Two bollards may protect hydrants that can be approached from only one side.
- 2) Hydrants may not require protection by bollards if they are located such that the potential for collision is minimal or if they are sufficiently protected by a standard concrete curb at least six inches in height.

E. Hydrant Markers and Color –

- 1) Blue reflective pavement markers (“blue dots”) shall be used to identify fire hydrant locations. Blue reflective markers used for any other purpose should be removed. See Attachment 28.
  - a) Two-way streets and roads – Markers shall be placed six inches from the edge of the painted centerline or from the approximate center of streets without a painted centerline on the side nearest the hydrant.
  - b) Streets with left turn lanes at the intersection – Markers shall be placed six inches from the edge of the painted white line on the side nearest the hydrant.
  - c) Streets with continuous two-way left turn lane – Markers shall be placed six inches from the edge of the painted yellow line on the side nearest the fire hydrant.
  - d) Freeways – Because of higher maintenance at these locations, markers shall be placed on the shoulder of the roadway one foot to the right of the painted edge line nearest the hydrant.

## 2) Hydrant Color

- a) Private hydrants (hydrants separated from the city main by and located downstream from a backflow prevention device) shall be painted OSHA safety red or equivalent. A plan for underground piping serving private hydrants shall be submitted to the Carlsbad for review and approval.
- b) Public hydrants shall be painted any color other than red as specified by the local water purveyor or city water department.

## 9. Access to Structures

- A. Hose pull – The dimension of 150 feet when used in relation to fire department access is commonly referred to as “hose pull distance.” As the name implies, this is the maximum distance that firefighters can effectively pull a fire hose or carry other equipment to combat a fire. The hose pull distance is set at 150 feet due to a variety of factors, including standard hose lengths, weight of equipment, hydraulic properties, and accepted operational procedures. See Attachments 29 and 30.
  - 1) Hose pull is measured along a path that simulates the route a firefighter may take to access all portions of the exterior of a structure from the nearest public road or fire lane. Under most circumstances, hose pull will not be a straight-line distance and should *not* be measured “as the crow flies.”
  - 2) All obstructions such as fences, planters, vegetation, and other structures must be considered when determining whether a building is accessible from a particular location on the fire access roadway. Topography may also affect the potential access route and any significant changes in elevation must be accounted for when measuring hose pull distances.
  - 3) Hose pull measurements begin at a point in the street located 10 feet from the edge of the curb.
- B. Access walkways - CFC 504.1 specifies the installation of approved access walkways from fire access roadways to exterior openings required by either the CBC or CFC. The City of Carlsbad may require the construction of such walkways depending upon particular site conditions or project parameters. These conditions include, but are not limited to, building use or occupancy, topography, vegetation, and surface conditions. Design professionals must carefully consider these issues when developing a project site.

- 1) Access walkways must be provided to all required egress doors from a building, all firefighter access doorways in buildings with high-piled storage, and the area beneath each emergency rescue opening. Access walkways will typically be required around the entire perimeter of a structure to facilitate control of a fire through any other available openings.
  - 2) Access walkways must be a minimum of five feet in width.
  - 3) Access walkways shall consist of a surface that lends itself to safe use during building evacuation, firefighting, and rescue efforts. Solid surface walkways such as concrete or asphalt are preferable, though alternative surfaces such as decomposed granite (DG), gravel, or grass are permissible under certain conditions. Ground covers and shrubs that prevent or impede laddering of structures are not permitted to be planted on or adjacent to access walkways.
  - 4) Where the grade itself presents a slip or fall hazard, an access walkway with a slip-resistant surface and/or stairway must be provided.
  - 5) The type of material provided for the access walkway and/or other specifications shall be indicated on the fire master plan and are subject to approval by the City of Carlsbad.
- C. Path of travel obstructions - Firefighter access to and emergency egress from required openings must remain free and unobstructed at all times. Architects, landscape designers, and facility managers must take care to ensure that fences, planters, and vegetation will not interfere with access and egress routes.
- 1) Fences - Walls, fences, hedges, and similar obstructions may not be located within the area designated as an access walkway unless a gate through the obstruction equipped with an approved padlock or Knox box has been provided for firefighters to access the perimeter of the structure. If the wall or fence blocks travel from required egress openings to the public way or an open area at least 50 feet from the structure ("safe dispersal area" per CBC 1027.5), a gate operable by the occupants evacuating the structure must be provided that allows unimpeded egress to the public way. Where doors in the path of emergency egress travel are required to be equipped with panic hardware, gates shall likewise be similarly equipped. These requirements may not apply to individual single family residences.
  - 2) Vegetation - As stated previously, certain types of ground cover and low-growing plants present an impediment to firefighting and rescue operations and are prohibited from being planted in the access walkway. In addition, taller vegetation such as shrubs and trees may not be located where they will, either when planted or upon maturation, present an obstruction to accessing

rescue windows. Raised planter areas are not allowed to be used as rescue ladder access points.

3) Key boxes and key switches - Knox devices shall be provided where necessary to ensure that immediate access for firefighting, rescue, and other emergency purposes is possible.

a) Location - At a minimum, Knox devices shall be provided for the following locations:

- i. gates along the paths of firefighter travel from the fire lane to all points along the perimeter of the structure;
- ii. gates to pool enclosures;
- iii. building gates or doors leading to interior courtyards containing rescue windows;
- iv. building gates or doors leading to exterior hallways providing access to residential units or tenant suites;
- v. gates in exterior enclosures containing hazardous or combustible material storage;
- vi. exterior doors to rooms containing main alarm panels or annunciators;
- vii. doors and gates providing access to parking structures;
- viii. doors and gates to other areas identified by the fire department.

When approved by the City of Carlsbad, a frangible padlock or chain that can be cut with bolt cutters or a Knox padlock may be used in lieu of a key box for exterior hazardous or combustible materials storage areas. Manually operated vehicle or pedestrian access gates that are not commonly used or required to be openable from the egress side may also be provided with a frangible padlock or chain.

Knox boxes or switches shall be located adjacent to and clearly visible from the gate or door served. They shall be securely mounted to a wall or fence at a height of four to six feet above grade in a location that is easily accessible to firefighters and, when required, police officers. Shared Knox devices (see section 9.C.3.e below) shall meet the installation requirements of both the Carlsbad Fire Department and the police



department unless otherwise approved by the applicable agency—refer to the local security or municipal ordinance for specific requirements. Where the potential for vandalism or tampering is significant, key boxes that are not submastered for police department use may be mounted higher than five feet with Carlsbad approval. Boxes and switches are not required to be electronically monitored; if they are, they shall not initiate an alarm signal that requires a response by the fire department.

- b) Key box Contents - The key used to unlock the gate or door shall be kept in the key box. When the key unlocks more than the individual adjacent gate or door, a label or tag shall be attached to the key identifying the gates or doors it operates. Where multiple gates or doors are served by a single box, two or more copies of the key(s) are recommended so that a copy will be available to each engine company responding to the site.
- c) Electric Locks – Electromagnetically or electromechanically locked pedestrian gates and doors shall be equipped either with a Knox box containing a key to open the lock or, if the door lock cannot be operated with a key from the exterior, a Knox key switch shall be provided adjacent to the door. Where key switches are provided, the door or gate lock shall remain disengaged until the key switch is returned to the “normal” closed or locked position.
- d) Vehicle gates - See sections 5.E through 5.G for more information on requirements for Knox boxes and key switches serving vehicle gates across fire lanes.

## **10. Access during construction**

Access and water supply during construction shall comply with CFC Chapter 33 and the provisions listed in this section and, where applicable, elsewhere in this guideline. Construction activities at job sites not complying with these requirements may be suspended at the discretion of the Carlsbad inspector until a reasonable level of compliance is achieved.

At no time shall construction projects impair or obstruct existing fire access roadways or access to and operation of existing fire hydrants serving other structures. Should existing roadways or hydrants need to be moved or otherwise altered during the course of construction, the developer shall provide alternative access routes and other mitigation features to ensure adequate fire and life-safety protection. Such alternatives and features shall be submitted to the Carlsbad for review and approval prior to alteration of existing conditions.

- A. Lumber drop inspection – an inspection shall be scheduled with a Carlsbad inspector to verify that access roadways and operable hydrants have been provided for buildings under construction.
- 1) For buildings of Type IV and V construction (and non-combustible structures that may have a portion of the exterior walls, façade, or other building elements comprised of wood or other combustible material), a lumber drop inspection shall occur prior to bringing combustible building materials on site.
  - 2) For other construction types (Type I, II, III) with exterior walls built of non-combustible materials, an inspection shall occur prior to commencing interior construction involving combustible materials (e.g., wooden mezzanines or partition walls, carpet, cabinetry or other woodwork, furniture, etc.). In concrete tilt-up and masonry buildings, wooden panelized roofing systems are exempt from this requirement.
  - 3) An inspection shall occur prior to construction reaching 40 feet in height for buildings of any construction type that will have four or more floors when complete.
  - 4) The street address of the site shall be prominently posted at each entrance. For projects on streets that do not have a name or street signs posted yet, the sign shall include the project name and tract/lot number.
  - 5) Gates through construction fencing shall be equipped with a Knox padlock or frangible lock/chain.
  - 6) When required by the Carlsbad inspector, fire lanes shall be posted with “Fire Lane—No Parking” signs or no parking areas shall be otherwise identified to maintain them free of obstructions during construction.
  - 7) Provisions shall be made to ensure that hydrants are not blocked by vehicles or obstructed by construction material or debris. A three-foot clear space shall be provided around the perimeter of the hydrant and no parking or similar obstructions shall be allowed along the adjacent road within 15 feet of the hydrant. Inoperable hydrants shall be bagged.
- B. Temporary Fire Access Roads - Temporary access roads (construction roads that do not match the final location and configuration of permanent roads as approved on a Fire Master Plan) and temporary hydrants may be permitted for *single family residential model construction or a single detached custom home less than 5,500 square feet in area* with the following conditions:

- 1) Plans for temporary access shall be submitted to the City of Carlsbad. Plans shall be drawn to scale and show permanent (existing) roadways, proposed temporary roadway locations, location of models, space dedicated to storage of construction materials, and parking for work crews and construction vehicles. The plans shall clearly state that they have been submitted for temporary access and hydrants.
- 2) Plans shall be stamped and signed by a licensed civil engineer stating that the temporary access road can support 72,000 pounds of vehicle weight in all-weather conditions. The road base material shall be over soil compacted to at least 90% and be mixed or topped with a suitable binding material to provide all-weather characteristics; road base alone does not satisfy this requirement.
- 3) Provide a parking plan for the construction site detailing how the fire lane no parking regulations will be enforced. Include a clause in the letter stating that “the job-site superintendent is responsible for informing the work crews of parking requirements and that the entire job-site is subject to shut-down by the Carlsbad inspector if parking is in violation of fire lane posting.” The letter shall be written on company letterhead and scanned onto the plan.
- 4) Aboveground invasion lines are acceptable for water supply.
  - a) Provide detailed drawings detailing how the line will be secured in place and protected from vehicular damage.
  - b) An invasion line may be run underground if the depth of bury can support the 72,000-pound weight of a fire apparatus.
  - c) The temporary water line must provide the required fire flow; calculations are required.
  - d) The pipe shall be listed for fire service.
  - e) Fire hydrants shall consist of a minimum 6” barrel with one 2-1/2” outlet and a 4” outlet. Note this on the plan.
- 5) All other access and water requirements shall apply (e.g., width, approach clearance, premises identification, locks, gates, barriers, etc.).
- 6) The approved plan for temporary access and water supply shall be available at the construction site prior to bringing combustible building materials on-site.
- 7) An inspection by the Carlsbad inspector is required to verify adherence to the approved plan prior to bringing combustible materials on-site.

C. Phased access - Incremental installation of permanent access roadways as shown on a fire master plan may be permissible for commercial and residential developments. If phased installation is anticipated, the site superintendent or designee shall review the installation process with a Carlsbad inspector during the lumber drop inspection or pre-construction meeting. Depending on the complexity of the installation, size of the project, and other project-specific factors, the inspector may allow phased installation to proceed immediately or may first require that all or some of the following items are satisfied:

- 1) Plans for phased access shall be submitted to the City of Carlsbad either as part of the original access plan submittal or as a revision to an approved fire access plan. Plans shall be drawn to scale and demonstrate that all access and water requirements are met during all phases of construction and that approval of one phase does not compromise or complicate completion of the subsequent phases. Plans shall show for each phase of construction:
  - a) The extent of building construction
  - b) Location of operable hydrants serving all buildings under construction
  - c) The location of construction fencing, barriers, and vehicle access gates
  - d) The location of all temporary or permanent "Fire Lane—No Parking" signs
  - e) Equipment/materiel staging locations
  - f) Worker parking areas (see item "4" below)
- 2) Phasing plans shall be stamped and signed by a licensed civil engineer stating that the access road can support 72,000 pounds of vehicle weight in all-weather conditions. The road base material shall be over soil compacted to at least 90% and be mixed or topped with a suitable binding material to provide all-weather characteristics; road base alone does not satisfy this requirement. The final road section less the final lift of asphalt topping may be acceptable if certified by the engineer.
- 3) The phasing plan shall identify any anticipated areas where fire department access roadways may be temporarily inaccessible due to trenching, slurry coating, striping, or other construction activities after they have been installed and inspected. The plan shall indicate the anticipated period of

impairment and include provisions for providing plating over trenches and alternative access routes, notification to the fire department, and/or other forms of mitigation when such roadways are impaired.

- 4) Provide a parking plan for the construction site detailing how the fire lane no parking regulations will be enforced. Include a clause stating that “the job-site superintendent is responsible for informing the work crews of parking requirements and that the entire job-site is subject to shutdown by the Carlsbad inspector if parking is in violation of fire lane posting.”
- 5) The approved phasing plan shall be available at the construction site prior to bringing combustible building materials on-site. A lumber drop inspection by a Carlsbad inspector will be required prior to the commencement of each phase.
- 6) All other access and water requirements shall apply (e.g., width, approach clearance, premises identification, locks, gates, barriers, etc.).

## INDEX OF ATTACHMENTS

NUMBER: SUBJECT .....	PAGE
1: Standard Fire Master Plan Notes .....	31
2: Fire Master Plan Submittal Checklist.....	34
3: Minimum Road Widths .....	35
4: Clearance for Typical Gated Community Guard House .....	36
5: Fire Apparatus Access Roadway Clearance .....	37
6: "S" Curves .....	38
7: Minimum Turnaround and Hammerhead Dimensions.....	39
8: Fire Lane Parking Violations .....	41
9: Red Curb Specifications.....	42
10: Fire Lane Entrance Sign Specifications .....	43
11: Alternative Location for Towing Company Information .....	44
12: Fire Lane No Parking Sign Specifications .....	45
12a: Cul-de-Sac Fire Lane No Parking Sign Specifications .....	46
12b: Alternative Fire Lane No Parking Sign Specifications .....	47
13: Fire Lane No Parking Sign Locations.....	48
13a: Fire Lane No Parking Sign Locations for Cul-de-sacs .....	49
14: Sign Mounting Specifications.....	50
15: Minimum Gate Setbacks .....	51
16: Fire Lane No Parking Signs for Gates and Barriers .....	52
17: Cul-de-sacs and Dead-end Roadways.....	53
18: Cul-de-sacs Longer than 150' with Islands.....	54
19: Cul-de-sacs up to 150' with Islands.....	55
20: Short Cul-de-sacs and Dead-end Roads.....	56
21: Eyebrows.....	57
22: Sample Parking Enforcement Letter .....	58
23: Fire Flow for One-and-Two Family Dwellings, R-3, R-4 Buildings, Townhouses Table B105.1(1).....	59
24: Fire Flow for Buildings Other than One-and-Two Family Dwellings, R-3, R-4 Buildings, Townhouses per Carlsbad Municipal Code, Table B105.2.....	60
25: Minimum Required Fire Flow and Flow Duration for Buildings Table B105.1(2).....	61
26: Hydrant Quantity and Spacing Table C102.1 .....	63
27: Protection of Hydrants, Detector Checks, FDCs, and other Appurtenances .....	64
28: Blue Dot Hydrant Marker Location .....	65
29: Hose Pull .....	66
30: Hose Pull vs. Hose lay.....	67

# ATTACHMENT 1

## Carlsbad Fire Department Access & Water Plan Notes

All of the notes listed in the INSPECTION REQUIREMENTS and GENERAL REQUIREMENTS sections shall be placed, verbatim, on the plan under the heading "FIRE DEPARTMENT ACCESS & WATER NOTES."

### INSPECTION REQUIREMENTS

1. Carlsbad site inspections are required for this project. Please schedule all field inspections at least 48 hours in advance. Inspections canceled after 1 p.m. on the day before the scheduled date will be subject to a re-inspection fee. Call (442) 339-2660 to schedule an inspection.
2. A lumber drop inspection shall be performed prior to bringing combustible materials (or combustible fixtures and finishes for structures of non-combustible construction). All-weather access roads capable of supporting 72,000 topped with asphalt, concrete, or equivalent shall be in place and hydrants operational at time of lumber drop inspection.
3. For projects with fuel modification, a vegetation clearance inspection is required prior to a lumber drop inspection. Use the fuel modification plan service request number to schedule the vegetation clearance inspection.
4. Phased installation of fire access roads requires additional inspections not covered by the fees paid at plan submittal. Contact (442) 339-2660 to arrange for additional inspections that may be needed and any fees that may be due.
5. An original approved, signed, wet-stamped Carlsbad fire access & water plan shall be available on-site at time of inspection.
6. Access roads and hydrants shall be maintained and remain clear of obstructions at all times during and after construction. Areas where parking is not permitted shall be clearly identified at all times. Obstruction of fire lanes and hydrants may result in cancellation or suspension of inspections.
7. Temporary fuel tanks of 60 or more gallons shall be reviewed, inspected, and permitted by the, City of Carlsbad prior to use.
8. The project address shall be clearly posted and visible from the public road during construction.
9. All gates in construction fencing shall be equipped with either a Knox or breakaway padlock.

10. Buildings of four or more stories shall be provided with stairs and a standpipe before reaching 40 feet in height.

## **GENERAL REQUIREMENTS**

1. Fire lane widths shall be measured from top face of the curb to top face of the curb for fire lanes with standard curbs and gutters and from flow-line to flow-line for fire lanes with modified curb designs (e.g., rolled, ramped, etc.). The developer is responsible to verify that all approved public works or grading department street improvement plans or precise grading plans conform to the minimum street width measurements per the approved Carlsbad fire department access & water plan and standards identified in Carlsbad Fire Department Access & Water Guideline for all portions of the fire access roads.
2. Permanent, temporary, and phased emergency access roads shall be designed and maintained to support an imposed load of 72,000 lbs. and surfaced to provide all-weather driving capabilities.
3. Fire lane signs and red curbs shall meet the specifications shown in Carlsbad Fire Department Access & Water Guideline and shall be installed as described therein. Additional fire lane markings may be required at the time of inspection depending on field conditions.
4. All fire hydrants shall have a “Blue Reflective Pavement Marker” indicating their location per the Carlsbad standard. On private property markers are to be maintained in good condition by the property owner.
5. Address numbers shall be located and be of a color and size so as to be plainly visible and legible from the roadway from which the building is addressed in accordance with Carlsbad Fire Department Access & Water Guideline.
6. Access gates shall be approved prior to installation and shall be in compliance with Chapter 5 of the CFC and Carlsbad Fire Department Access & Water Guideline.
7. Approved access walkways shall be provided to all required openings and all rescue windows.
8. Vegetation shall be selected and maintained in such a manner as to allow immediate access to all hydrants, valves, fire department connections, pull stations, extinguishers, sprinkler risers, alarm control panels, rescue windows, and other devices or areas used for firefighting purposes. Vegetation or building features shall not obstruct address numbers or inhibit the functioning of alarm bells, horns, or strobes.
9. Dumpsters and trash containers larger than 1.5 cubic yards shall not be stored in buildings or placed within 5 feet of combustible walls, openings or combustible roof eave lines unless protected by an approved sprinkler system.



10. Any future modification to the approved Fire Department Access & Water Plan or approved site plan, including but not limited to road width, grade, speed humps, turning radii, gates or other obstructions, shall require review, inspection, and approval by the, City of Carlsbad.
11. Approval of this plan shall not be construed as approval of any information or project conditions other than those items and requirements identified in Carlsbad Fire Department Access & Water Guideline and related portions of the CFC and CBC. This project may be subject to additional requirements not stated herein upon examination of actual site and project conditions or disclosure of additional information.

# ATTACHMENT 2

## Fire Department Access & Water Plan Submittal Checklist

### PROJECT INFORMATION

- Scope of project is clearly defined on the plan?  Yes
- Conditional Use Permit conditions included with submittal?  Yes  N/A (CUP was not required by city)
- Tract/Tentative Tract/Parcel Map Number has been provided?  Yes
- Standard Carlsbad fire master plan notes are included?  Yes
- Building area, construction, occupancy, sprinklers noted on plan?  Yes
- Allowable area calculation provided on plan?  Yes  N/A (Building less than 6000 sq.ft.)
- AM&M request letter scanned onto plan?  Yes  N/A (No alternate methods proposed)
- Sheets not relevant to fire master plan removed from plan set?  Yes
- Access/hydrant phasing plan provided?  Yes  N/A (No phasing of access/hydrant installation)

### WATER AND HYDRANTS

- Water availability form completed and provided?  Yes  No
- All hydrants within 400' of the site are shown on plan?  Yes
- Are hydrants provided/spaced per CFC Appendix C?  Yes

### ACCESS AND ROADWAYS

- Extent of the access roadway is clearly shown on the plan?  Yes
- Turning radii and width (incl. road sections) shown on the plan?  Yes
- Exterior of all structures within 150' hose pull distance?  Yes  No (Mitigation proposed via AM&M)
- Engineer's certification provided for new paving?  Yes  N/A (No new paving)
- Walkable surface provided to required openings?  Yes
- Road and walkway grades >10% shown on plan?  Yes  N/A (Grade <10%)

### FIRE LANE IDENTIFICATION

- Red curbs are identified with bold or dashed lines?  Yes  N/A (Signs provided)
- Location of each "Fire Lane—No Parking" sign shown?  Yes  N/A (Red curbs provided)
- Fire lane entrance sign provided at each vehicle entrance?  Yes
- Detail drawings of red curbs/"No Parking"/entrance signs shown?  Yes

### GATES AND OBSTRUCTIONS

- Are all gates, fences, and planters shown?  Yes
- Are vehicle gates identified as manual or electric?  Yes  N/A (No gates)
- Manual vehicle gates have "No Parking" sign noted?  Yes  N/A (No manual gates)
- Knox boxes/locks/switches are noted on plans?  Yes  N/A (No gates)
- Carlsbad gate notes/specifications included on plan?  Yes  N/A (No gates)
- Knox form completed?  Yes  N/A (No gates)

### OTHER REQUIREMENTS


- Premises ID/address monument location shown on plan?  Yes  N/A (Single family homes)
- Trash enclosures are located at least 5' from buildings?  Yes  No (Enclosures are sprinklered)
- Two entry points provided for 150 or more residences?  Yes  N/A (Non-residential project)
- Parking enforcement letter provided?  Yes  N/A (Public streets only)

*NOTE: This is only a listing of basic fire master plan submittal requirements. Other information or requirements may be necessary depending on conditions specific to each project.*

# ATTACHMENT 3

## Minimum Road Widths


Measured from top face of curb to top face of curb for standard vertical curbs or flow line to flow line for rolled, ramped, or other curb types.

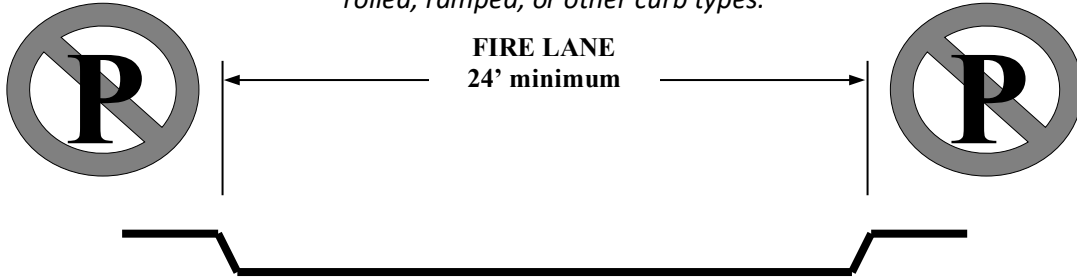

**ROADWAY LESS THAN 28'**

*Parking prohibited.*


*Roadway is required to be posted as a fire lane.*

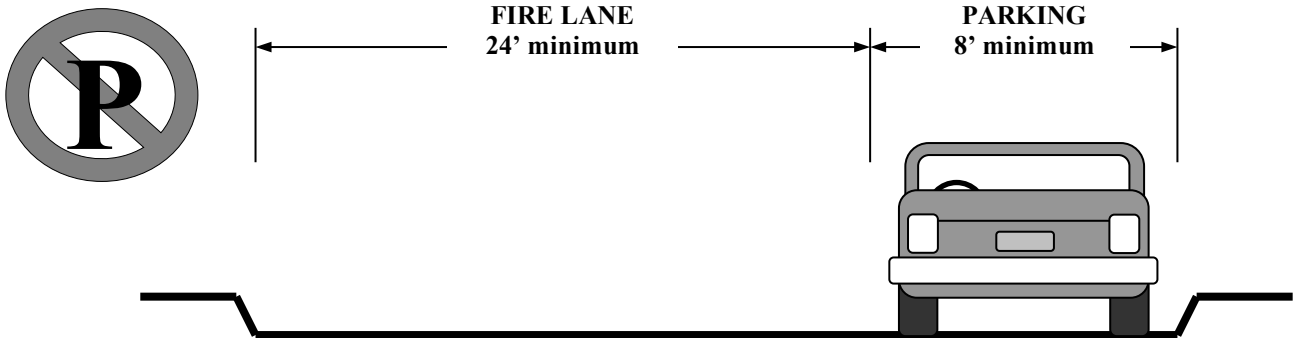

**ROADWAY AT LEAST 28' BUT LESS THAN 36'**

*Parking permitted on one side only.*

*Roadway is required to be posted as a fire lane.*

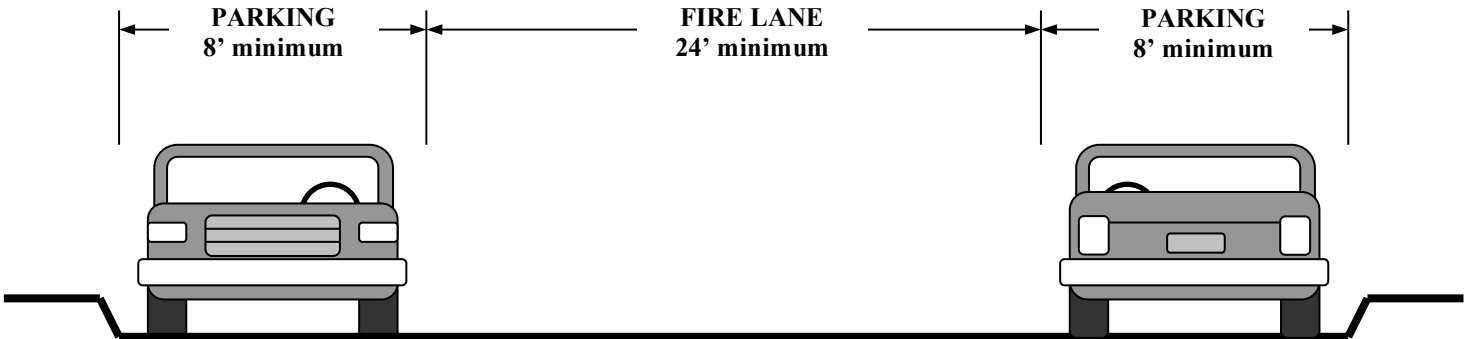


**ROADWAY 36' OR WIDER**

*Parking permitted on both sides*

# ATTACHMENT 4


## Fire Apparatus Access Roadway Clearance For Typical Gated Community Guard House

*Fire lane width reductions detailed below are applicable only to the area immediately adjacent to the guard house or gate. Roads leading up to and beyond the guard house or gate shall meet standard fire lane width requirements prescribed in Section 2.A.5 of this guideline.*

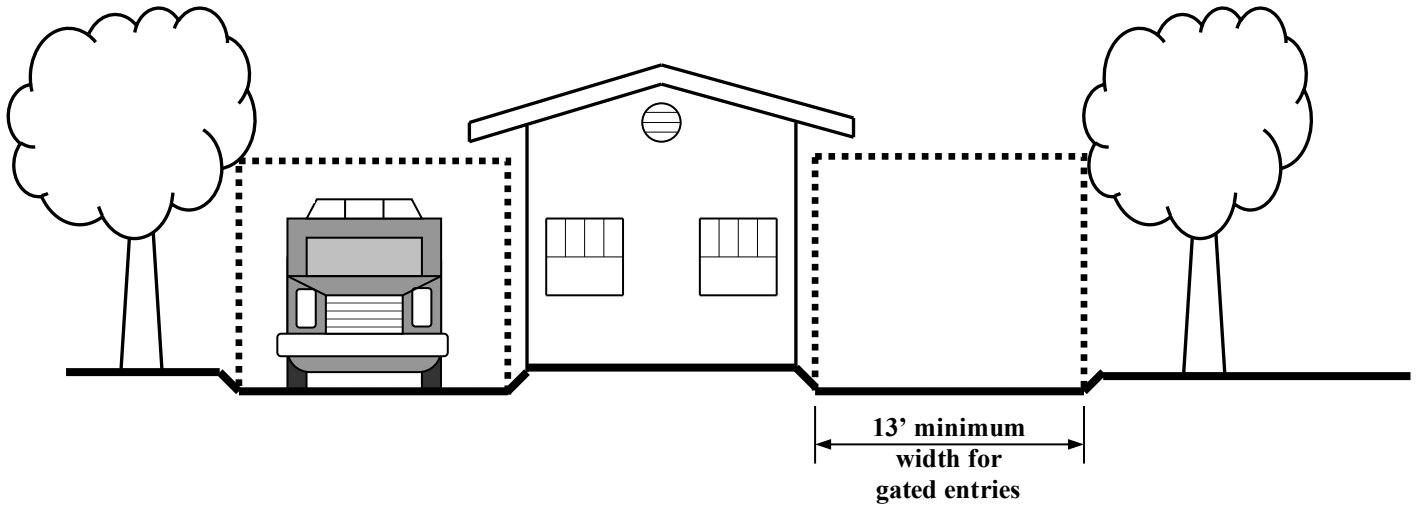

### PROPER CLEARANCE PROVIDED

*Eaves and vegetation do not encroach upon the 13'-wide by 13'-6" high minimum dimensions allowed for the fire access roadway next to the guard house.*

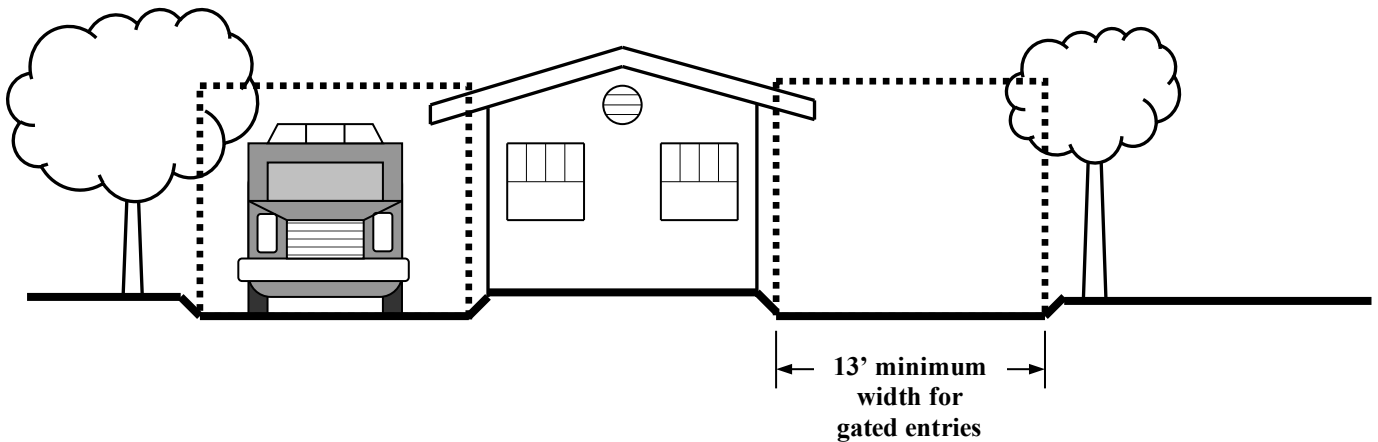


### INSUFFICIENT CLEARANCE

*While a 13'-wide access roadway is provided next to the guard house, eaves and vegetation encroach upon the minimum clear height of the fire lane.*

# ATTACHMENT 5

## Fire Apparatus Access Roadway Clearance

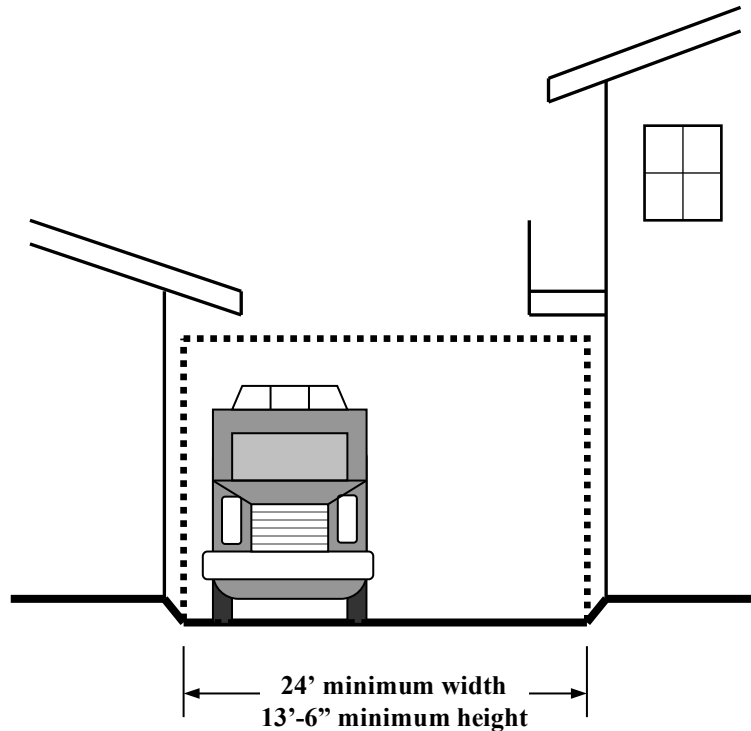


### PROPER CLEARANCE PROVIDED

*Eaves, balconies, and other obstructions do not encroach upon the 24' wide by 13'-6" high fire access roadway envelope.*

# ATTACHMENT 6

## "S" Curves

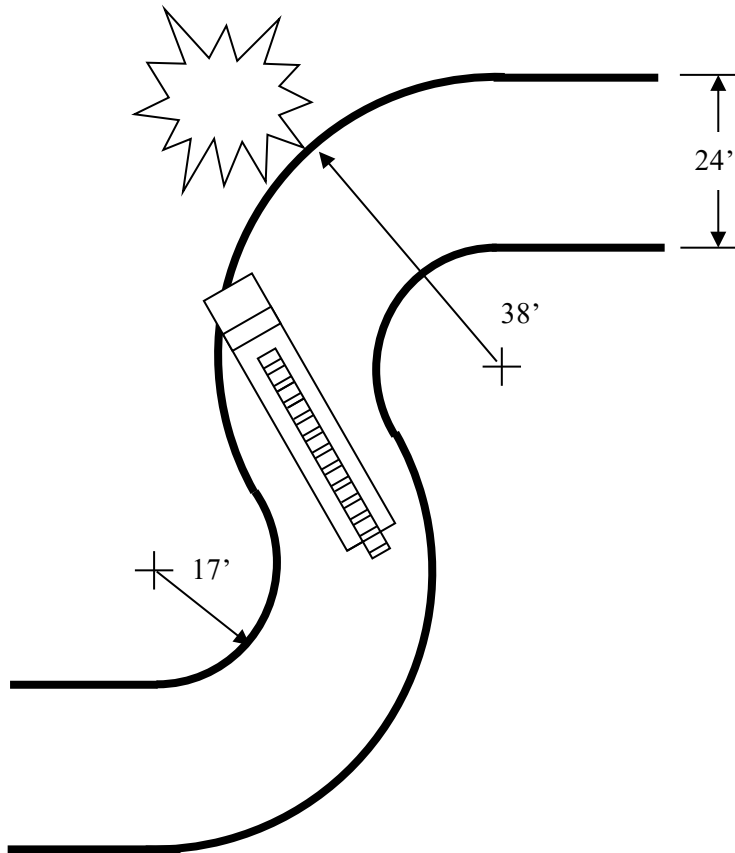

**NOT PERMITTED**  
Carlsbad fire apparatus are unable to negotiate tight "S" curves, such as the one shown to the left.



### PERMITTED

A 56' straight leg is required between the turns in a compound curve to provide sufficient recovery distance for the apparatus. Alternatively, the length of the straight leg may be reduced if the road width and/or turning radii are increased to allow for a wider turn.

# ATTACHMENT 7


## Minimum Turnaround and Hammerhead Dimensions

NOTE: Parking is not permitted in these turnarounds at the dimensions shown.

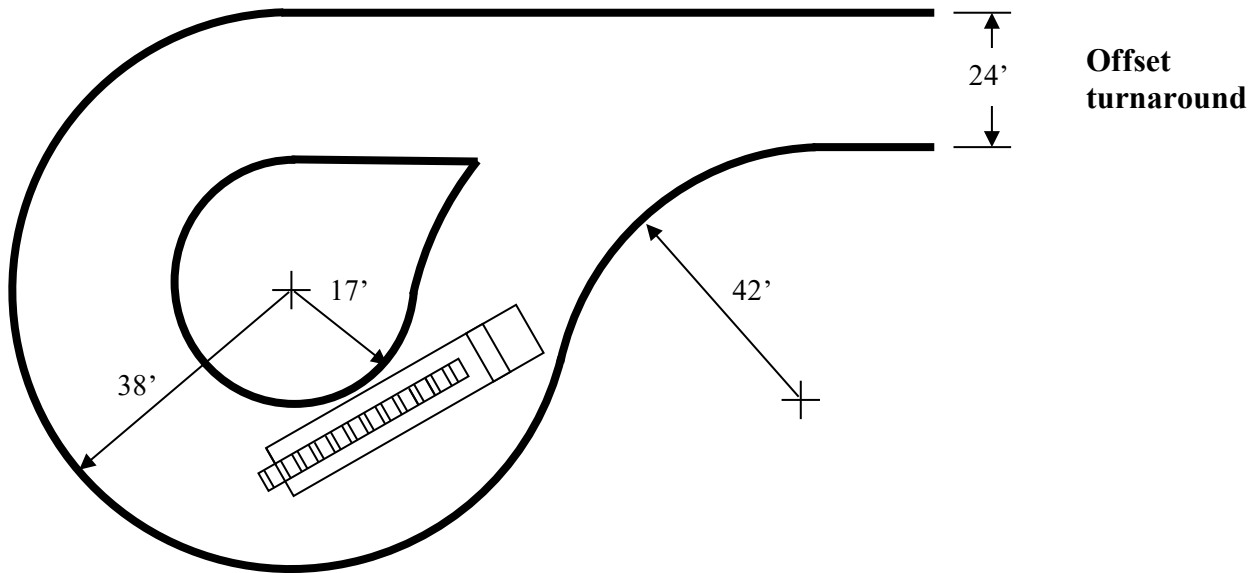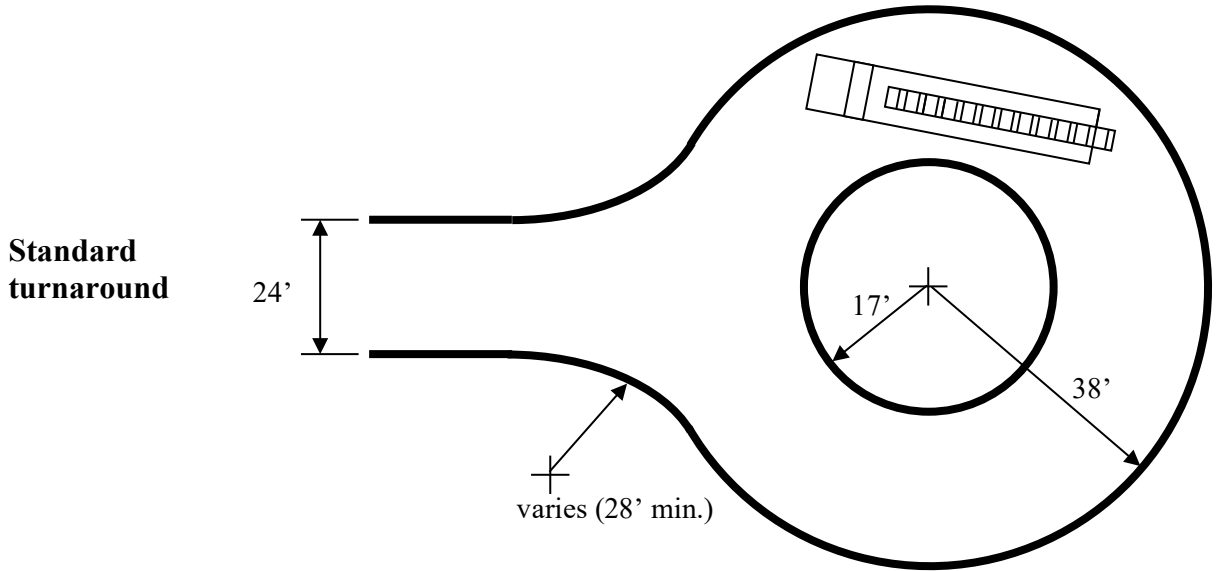

NOTE: Parking is not permitted in any of these hammerheads at the dimensions shown.

\* Wherever possible, increase this dimension by five feet.

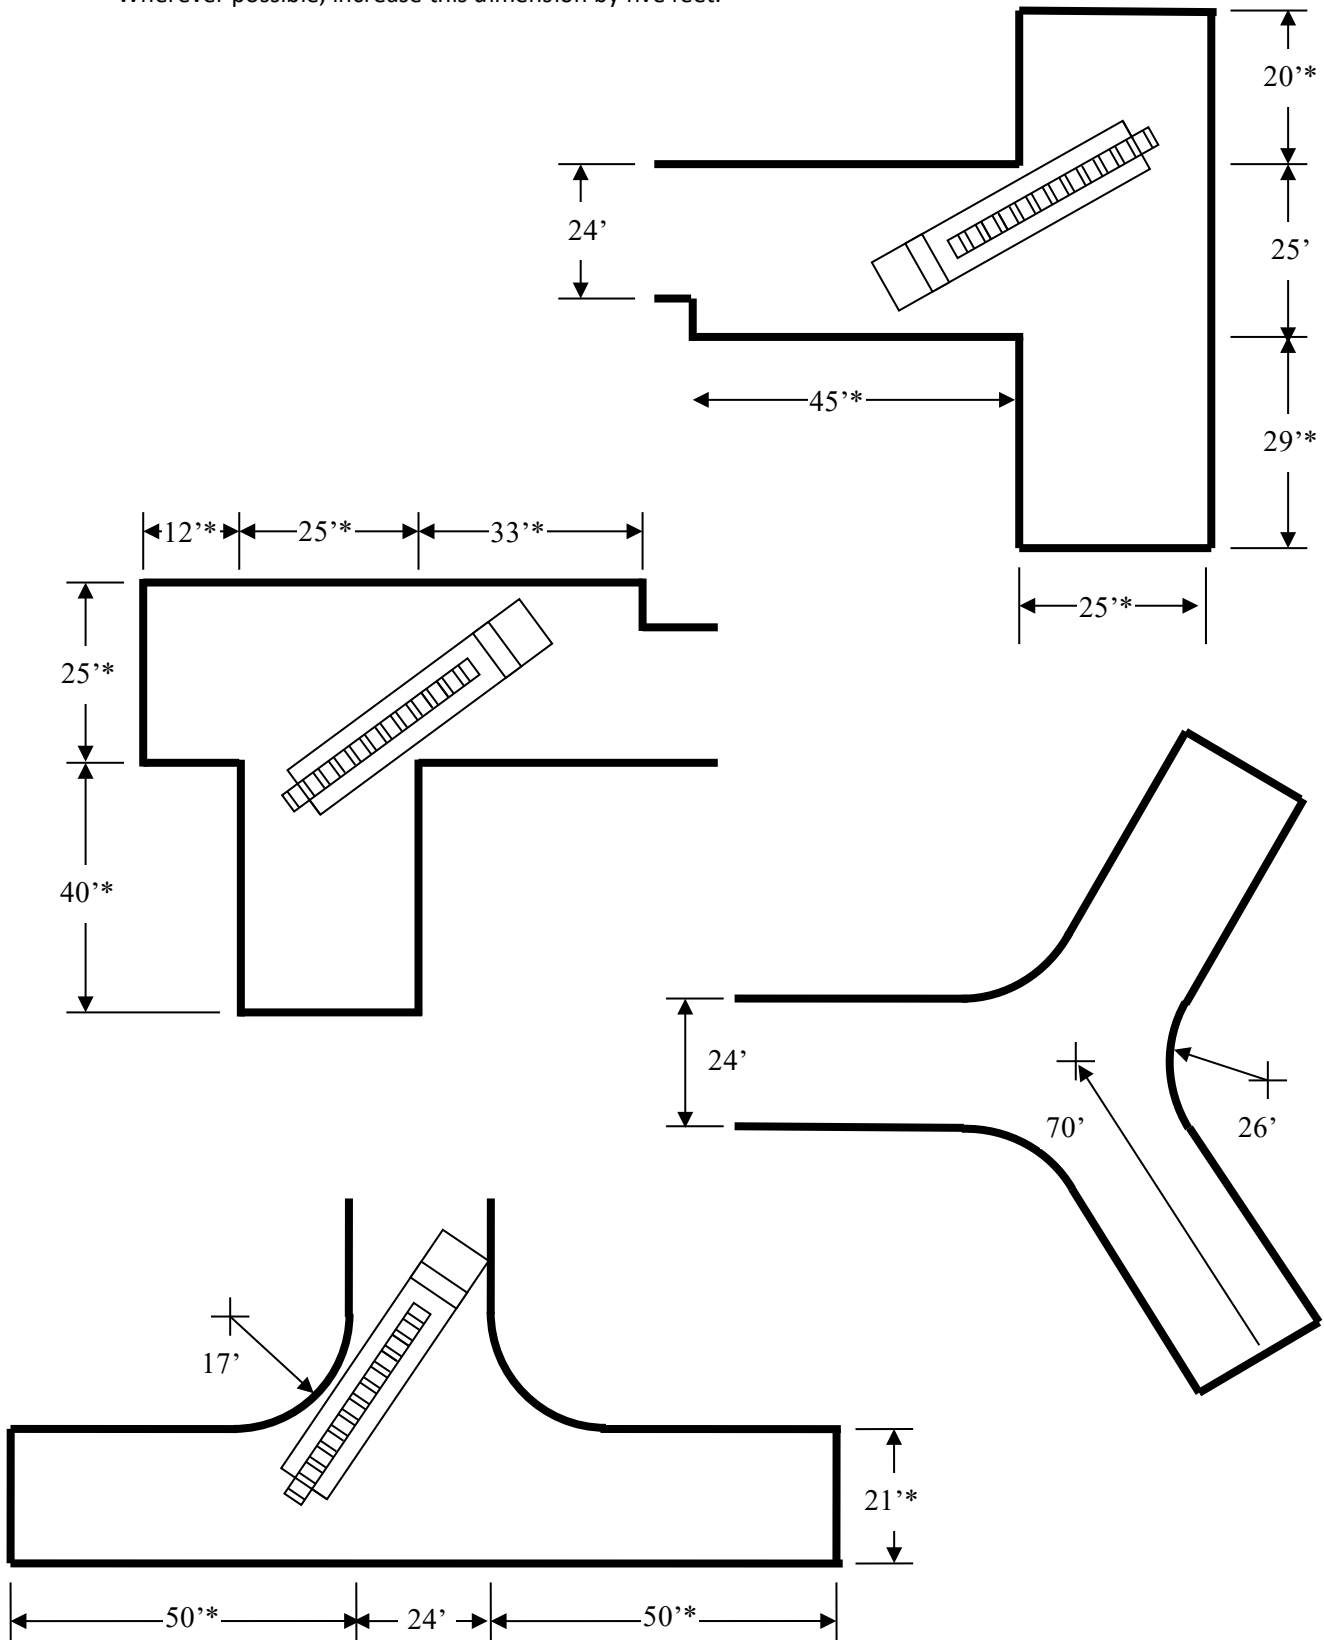



# ATTACHMENT 8


## Fire Lane Parking Violations

The California Fire Code (CFC) and California Vehicle Code (CVC) specify rules of the road for stopping, standing, and parking in fire lanes or near fire hydrants.

- A. Section 22500.1 states that no person shall stop, park, or leave standing any vehicle whether attended or unattended, in any location designated as a fire lane by the, City of Carlsbad except when necessary to avoid conflict with other traffic or in compliance with the direction of a peace officer or official traffic control device. Vehicles illegally parked in a fire lane may be towed per CVC 22953(b).
- B. There shall be no parking of any vehicles other than fire department vehicles within 15 feet of either side of a fire hydrant in accordance with CVC 22514(c). Such vehicles may be towed per CVC 22651(e).
- C. CVC 22658(a) permits the owner or person in lawful possession of any private property, subsequent to notifying local law enforcement, to cause the removal of a vehicle parked on such property to the nearest public garage, if:
  - 1) A sign is displayed in plain view at all entrances to the property specifying:
    - a) The ordinance prohibiting public parking, *and*
    - b) A notation indicating that vehicles will be removed at the owner's expense, *and*
    - c) The telephone number of the local traffic law enforcement agency, *or*
  - 2) The lot or parcel upon which the vehicle is parked has a single-family dwelling.
- D. CFC 503.4 states that the required width of a fire apparatus access road shall not be obstructed in any manner, including parking of vehicles. Minimum required widths and clearances shall be maintained at all times.
- E. CFC 507.5.4 states that vehicles and other obstructions shall not be placed or kept near fire hydrants, fire department inlet connections or fire-protection system control valves in a manner that would prevent such equipment or fire hydrants from being immediately discernible. The fire department shall not be deterred or hindered from gaining immediate access to fire-protection equipment or hydrants.

# ATTACHMENT 9

## Fire Lane Identification – Red Curbs

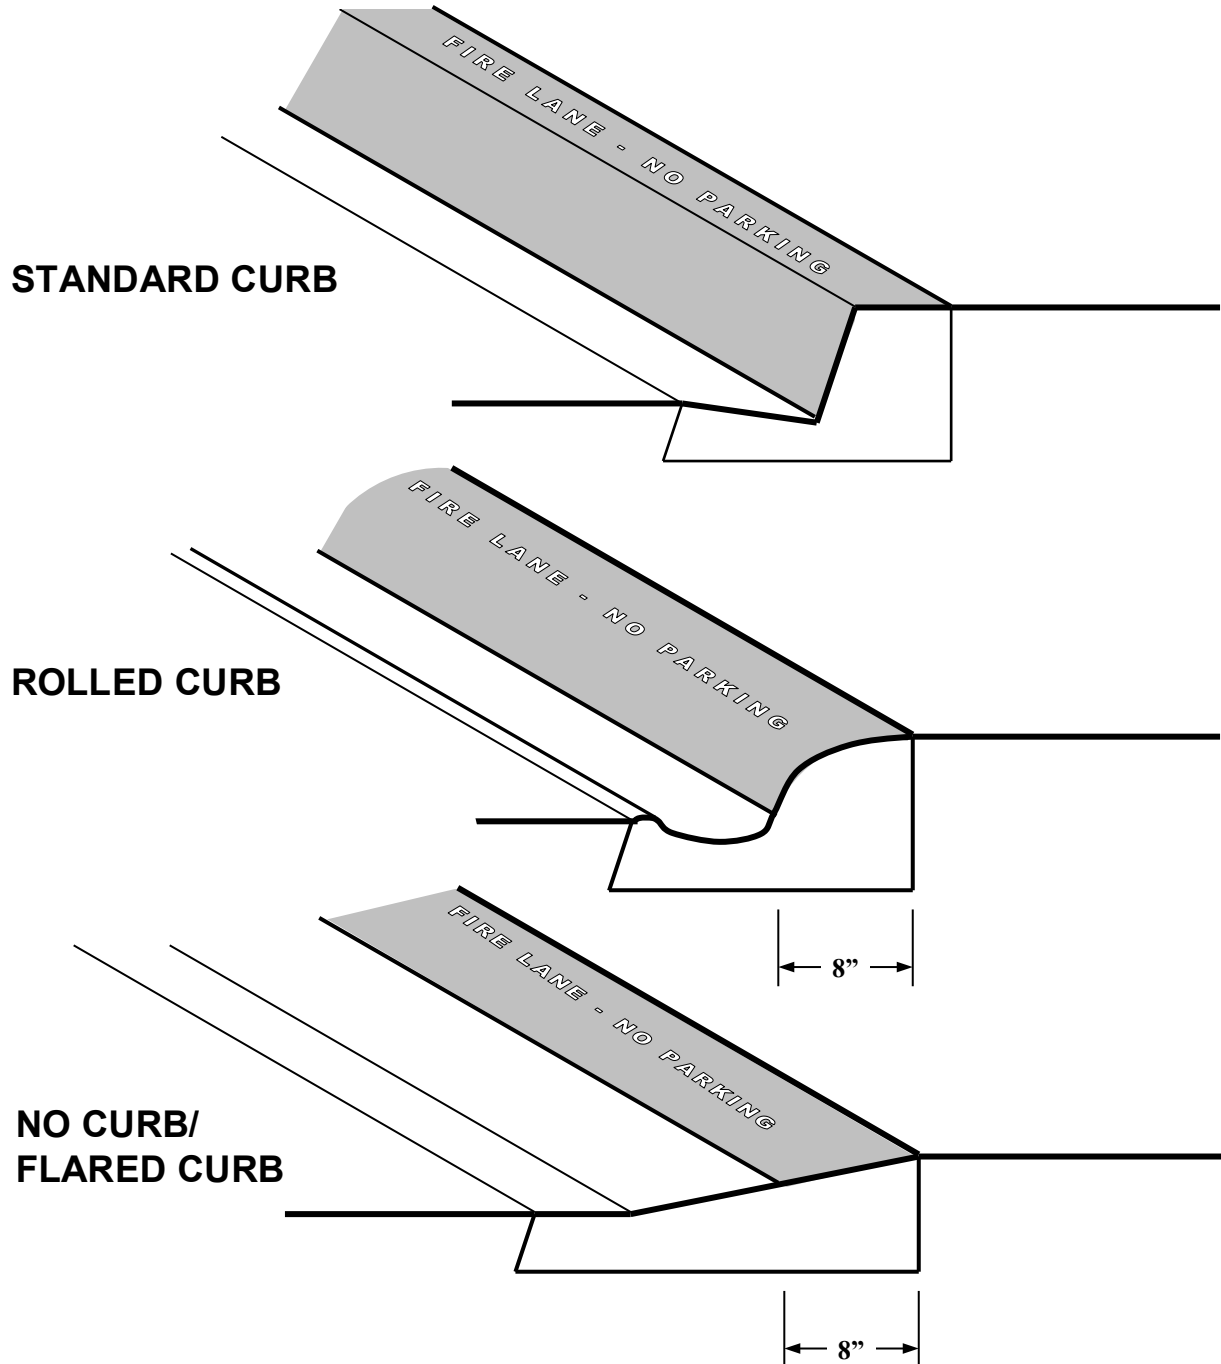


1. Fire lane entrance sign(s) shall also be provided per Attachment 10 or 11.
2. Curbs shall be painted OSHA safety red.
3. "FIRE LANE – NO PARKING" shall be painted on top of curb in 3" white lettering at a spacing of 30' on center or portion thereof.

# ATTACHMENT 10

## Specifications for Fire Lane Entrance Signs

To be used only at *vehicle entry points*  
to areas that contain “Fire Lane—No Parking” signs or red curbs

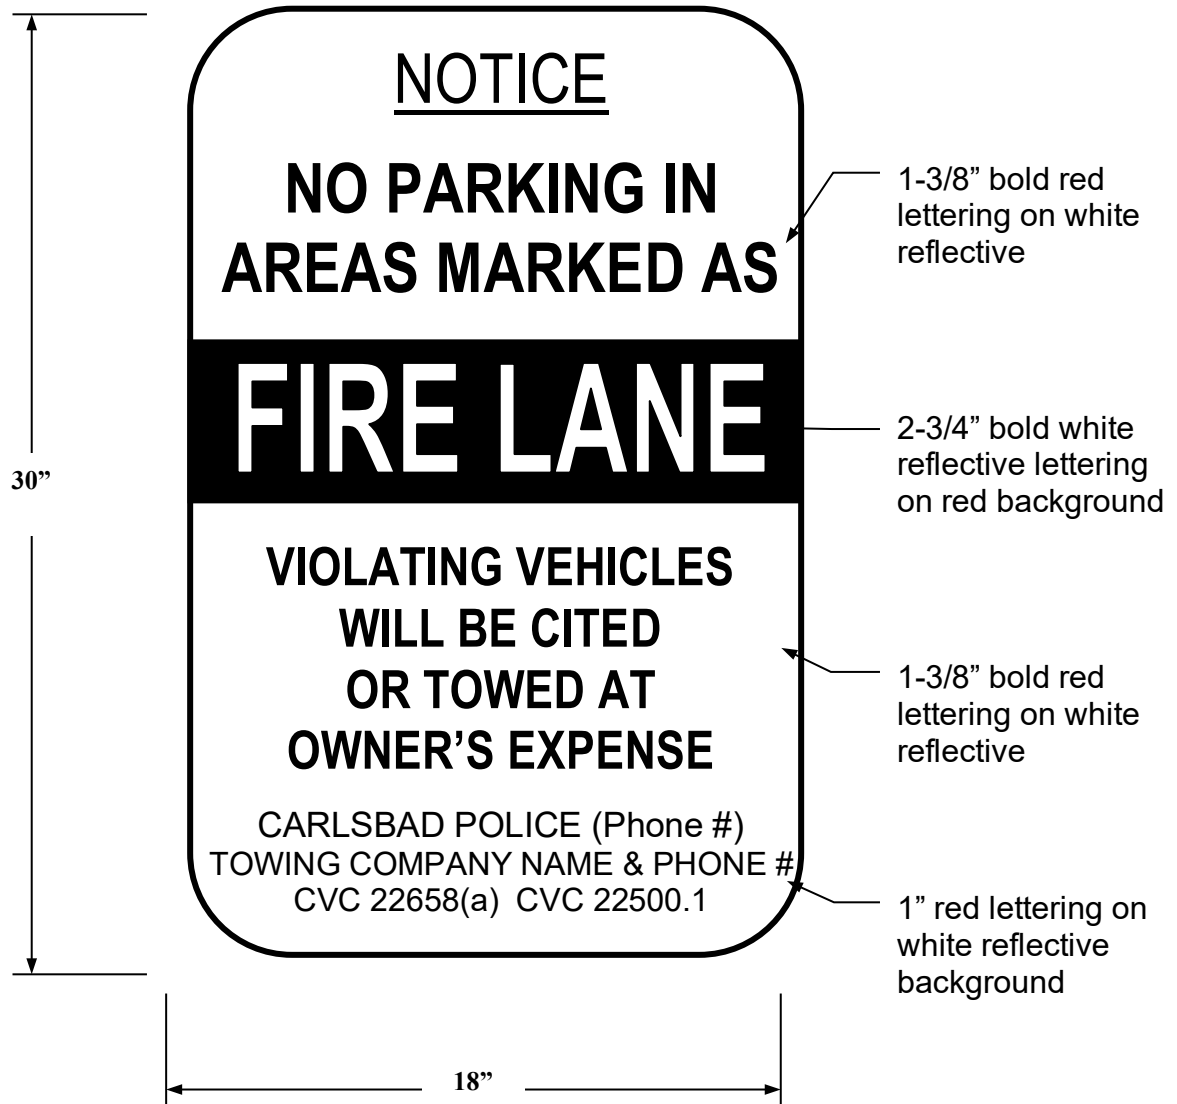

All sign and lettering dimensions shown are minimums. “Arial Narrow” font used is used in sample above though other legible sans-serif fonts may be acceptable.


This sign shall be posted at all vehicle entrances to areas marked with either red curbs or fire lane “No Parking” signs. Signs shall be securely mounted facing the direction of travel and clearly visible to oncoming traffic entering the designated area. Signs shall be made of durable material and installed per Attachments 13 and 14.

Towing company contact information is required for all properties with a standing written agreement for services with a towing company per the California Vehicle Code.



# ATTACHMENT 12

## Specifications for Fire Lane No Parking Signs

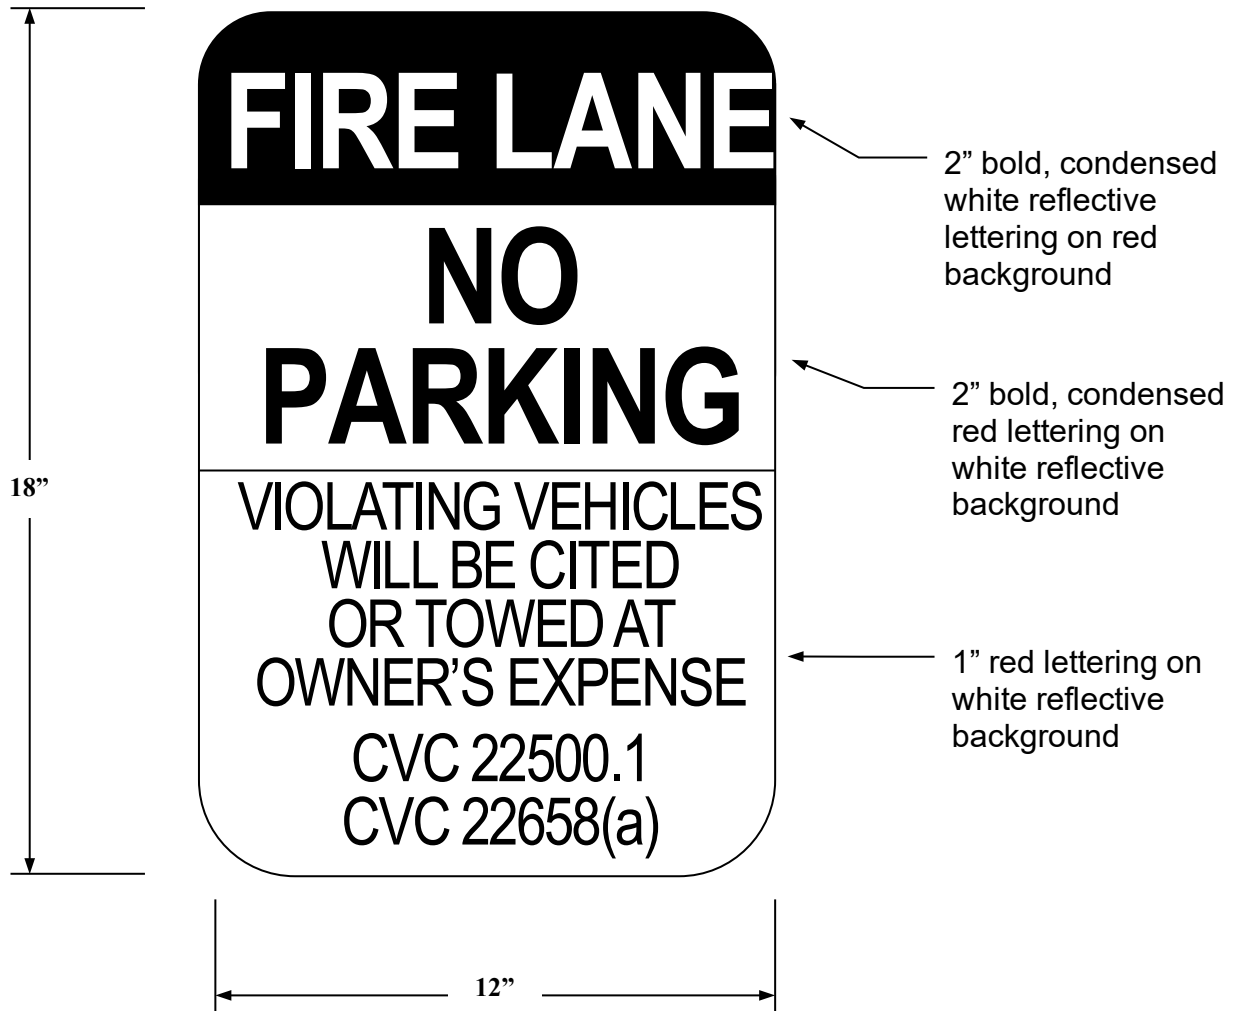


All sign and lettering dimensions shown are *minimums*. "Arial Narrow" font used is used in sample above though other legible sans-serif fonts may be acceptable.

Signs shall be securely mounted facing the direction of travel and clearly visible to oncoming traffic entering the designated area. Signs shall be made of durable material and installed per Attachments 13 and 14.

# ATTACHMENT 12a

## Specifications for Cul-de-Sac Fire Lane No Parking Signs

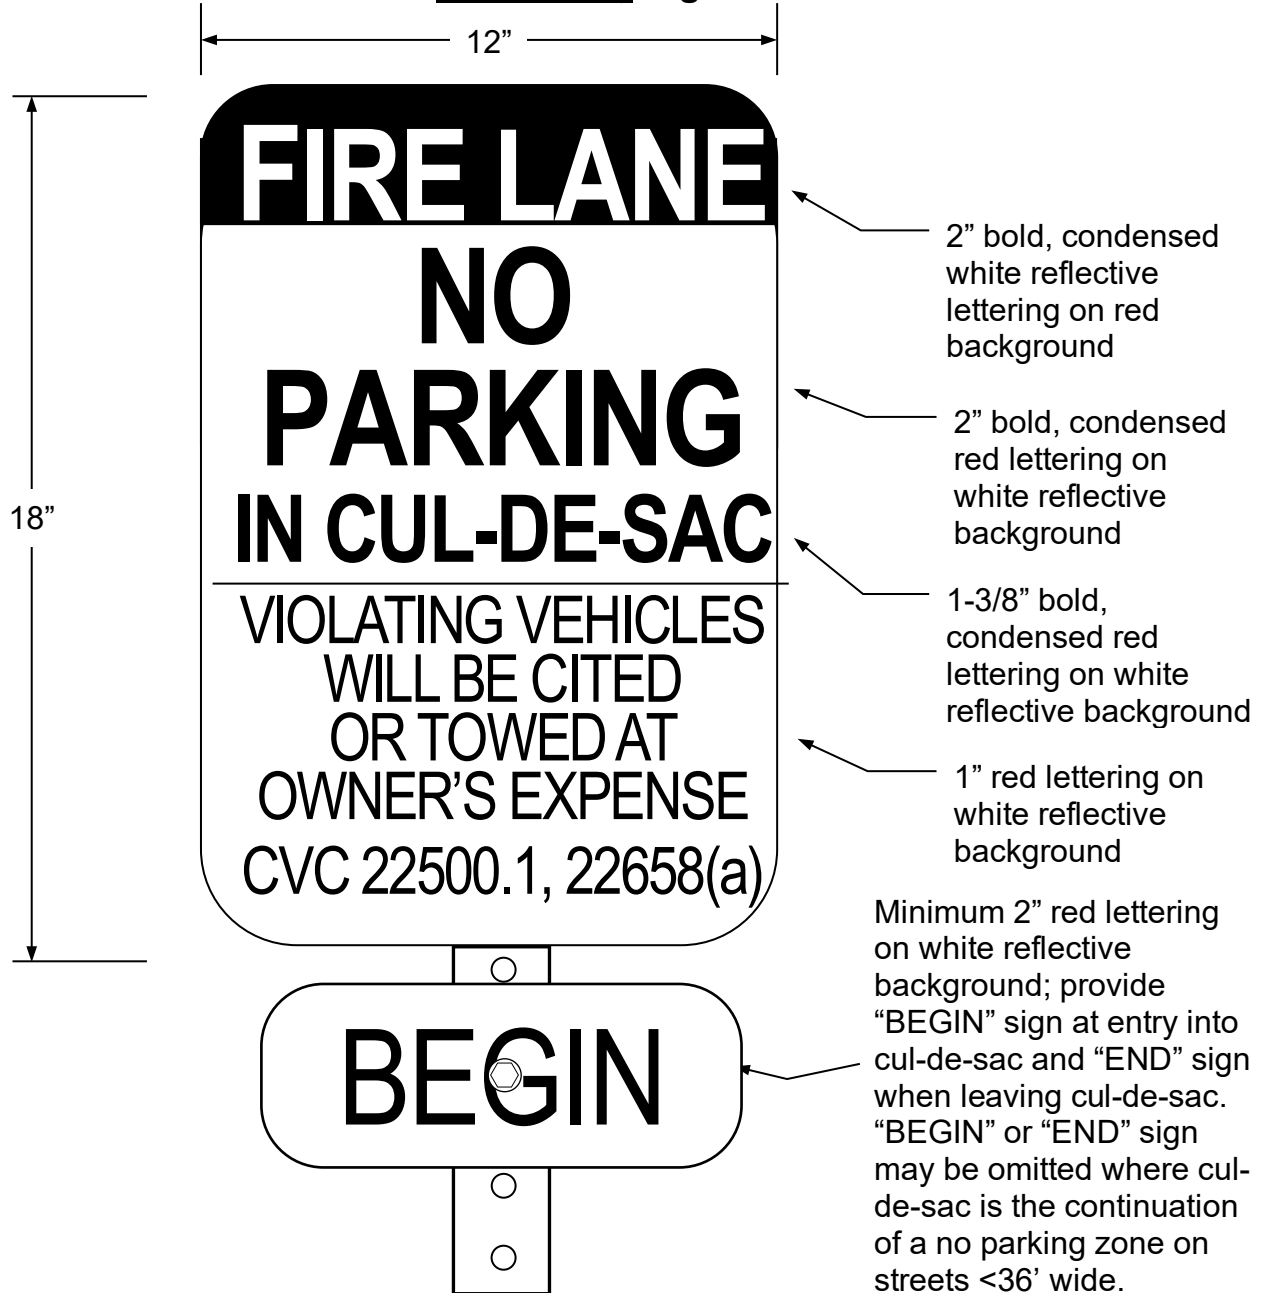

All sign and lettering dimensions shown are *minimums*. "Arial Narrow" font used is used in sample above though other legible sans-serif fonts may be acceptable.

Signs shall be securely mounted facing the direction of travel and clearly visible to oncoming traffic entering the designated area. Signs shall be made of durable material and installed per Attachments 13 and 14.

# ATTACHMENT 12b

## Specifications for Alternative Fire Lane No Parking Signs



← Additional verbiage shall be 1" bold, condensed red lettering on white reflective background. Where parking stalls are not present, sign may omit "except in designated stalls" and sign height may be reduced to 18".


Specifications for the rest of the sign shall match those of standard fire lane no parking signs.

All sign and lettering dimensions shown are *minimums*. "Arial Narrow" font used is used in sample above though other legible sans-serif fonts may be acceptable.

Signs shall be securely mounted facing the direction of travel and clearly visible to oncoming traffic entering the designated area. Signs shall be made of durable material and installed per Attachments 13 and 14.

# ATTACHMENT 13

## Fire Lane No Parking Sign Locations

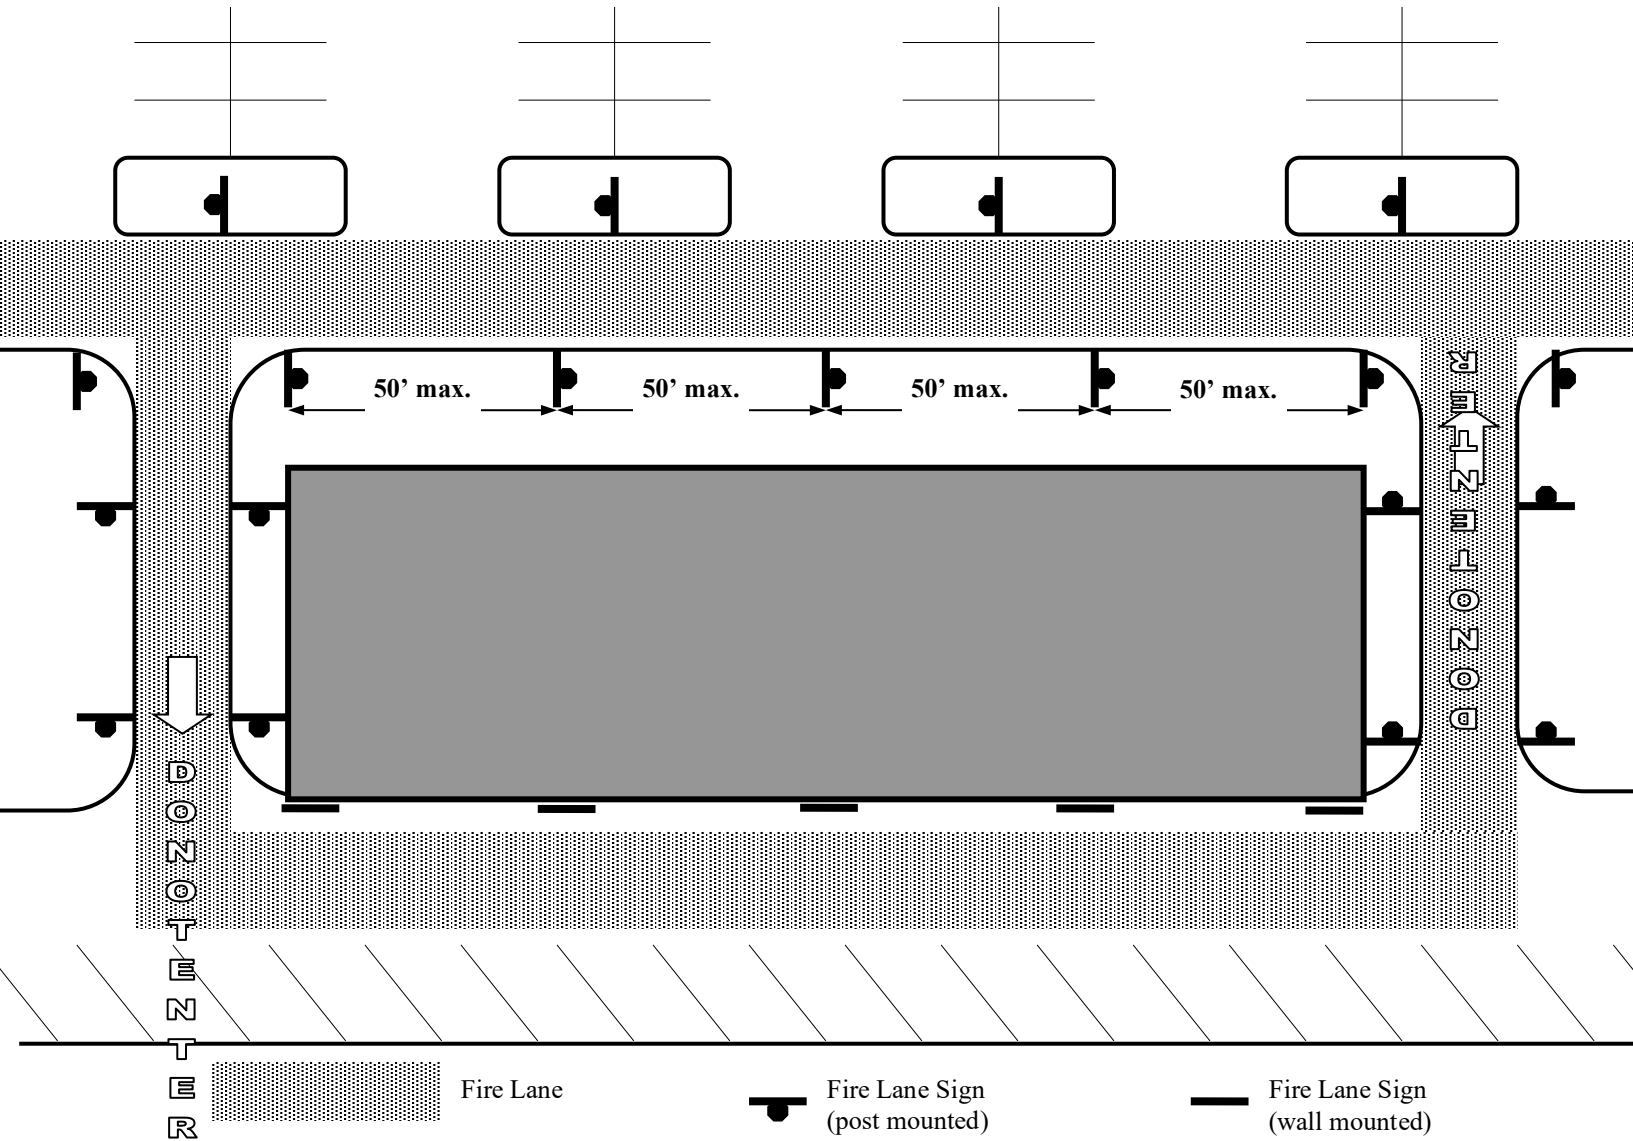


Signs are required within 3' of the end of each designated fire lane and spaced a maximum of 50' along the entire designated lane. One sign is required for each island adjacent to the fire lane.

Signs shall be securely mounted facing the direction of travel and clearly visible to oncoming traffic entering the designated area. Signs shall be made of durable material and installed per Attachment 14. Where signposts are not practical, signs may be mounted on a wall or fence. Carlsbad inspectors will determine if additional signs or sign locations are required.





# ATTACHMENT 13a

## Fire Lane No Parking Sign Locations for Cul-de-sacs

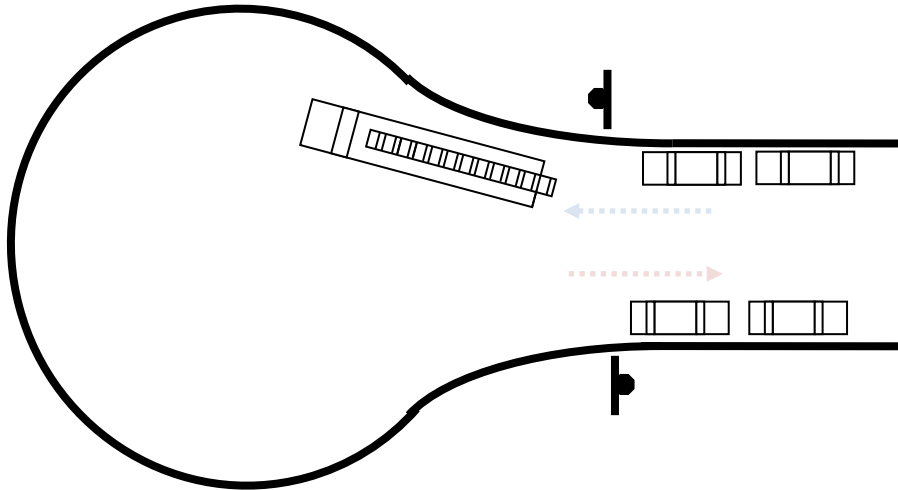

**Standard 38' radius cul-de-sac**  
"no-parking entire cul-de-sac begin" and "end" signs shall be located at the point where the street begins to widen into the bulb (see Attachment 12a)


**Offset 38' radius cul-de-sac:** "no-parking entire cul-de-sac begin" and "end" signs shall be located at the point where the street begins to widen into the bulb and at a point 38' from where the cul-de-sac and street are tangent (see Attachment 12a)

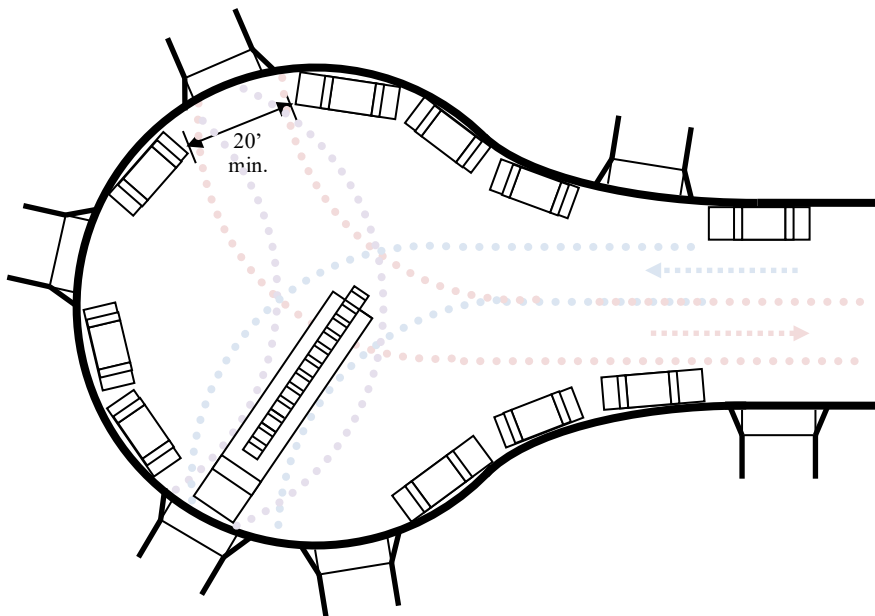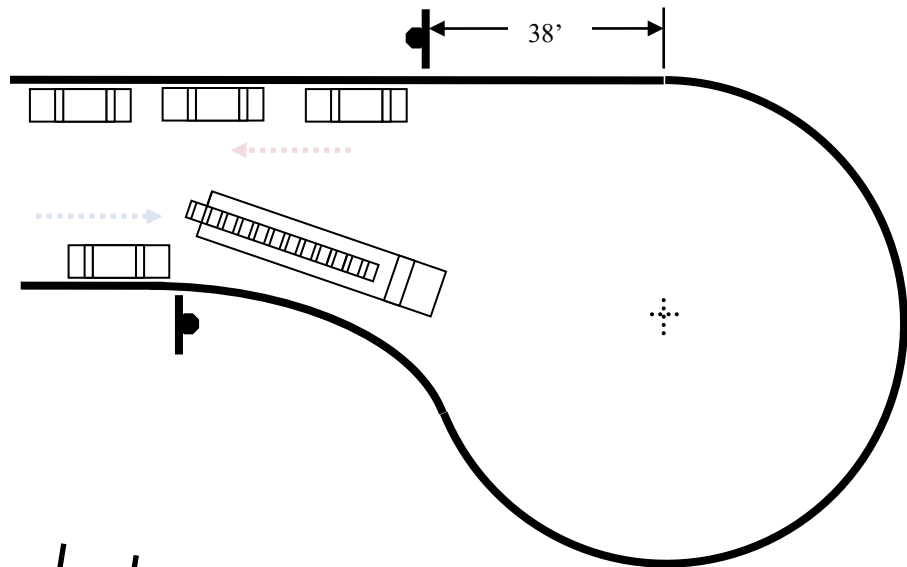

Where size and placement of driveways ensure sufficient space is available to execute a three-point turn, no-parking signs are unnecessary.

# ATTACHMENT 14

## Mounting Specifications for Fire Lane Entrance and No Parking Signs

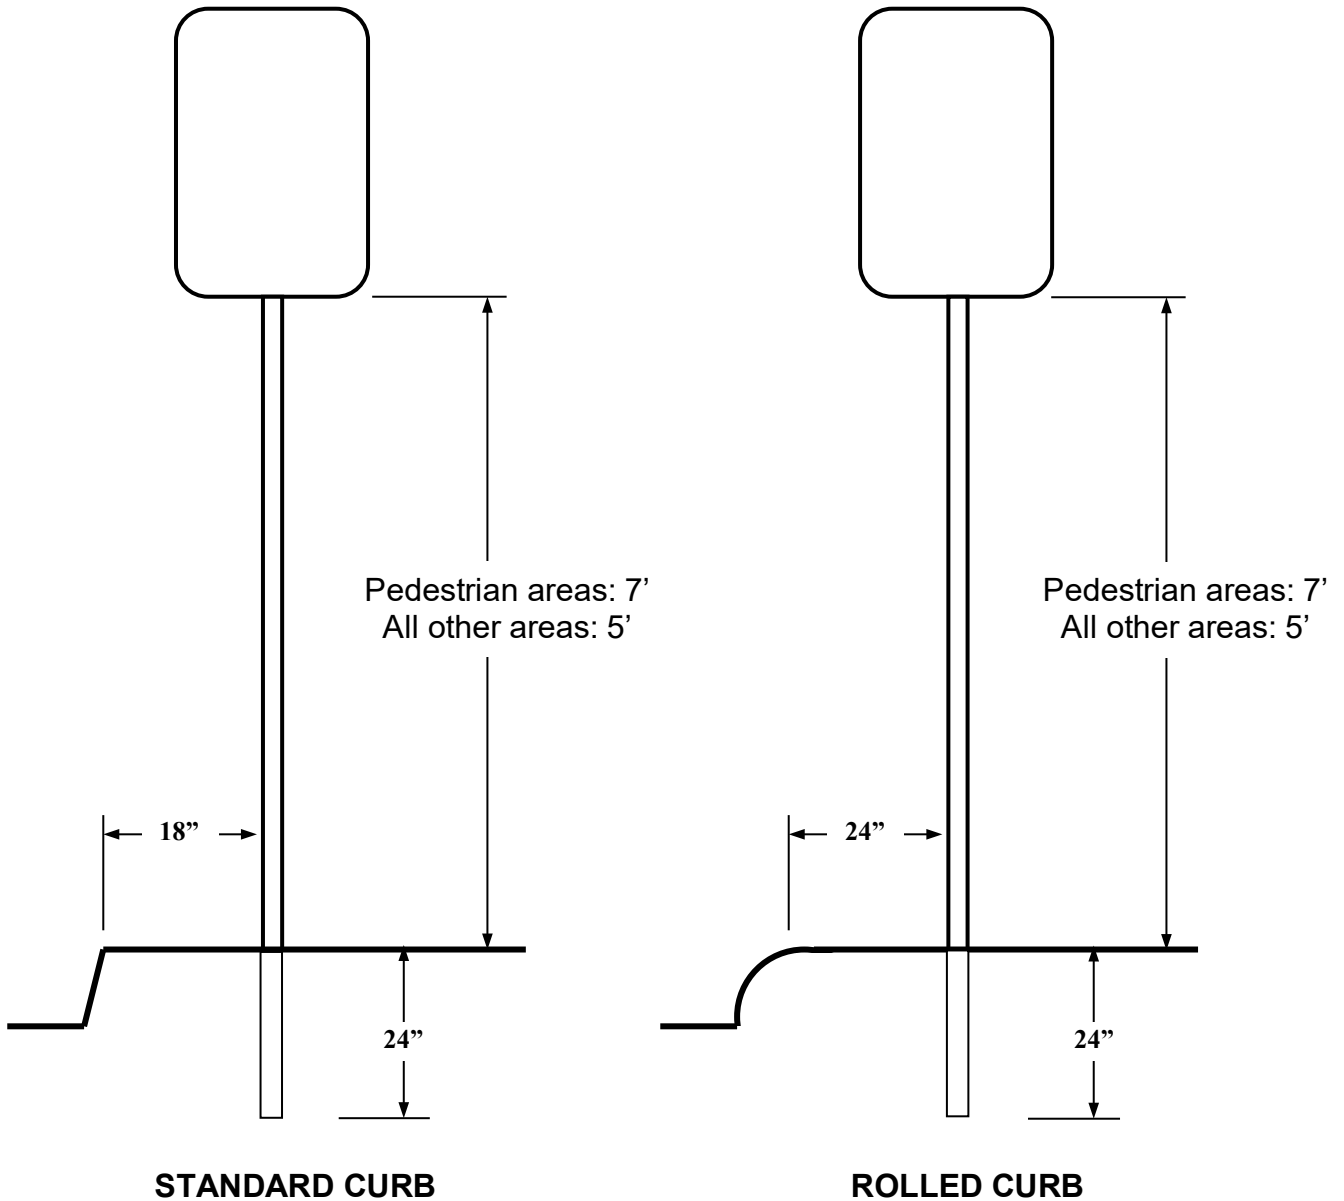


Signs shall be mounted facing the direction of vehicular travel.

Signs may be mounted on existing posts or buildings where the centerline of the sign is no more than 24" from the edge of the roadway.

Depth of bury shall be a *minimum* of 24" and rebar, a concrete footing, or another method to prevent removal of the sign is recommended. Footings for signs located in the public right-of-way shall be per the local jurisdiction's requirements.



# ATTACHMENT 15

## Minimum Gate Setbacks

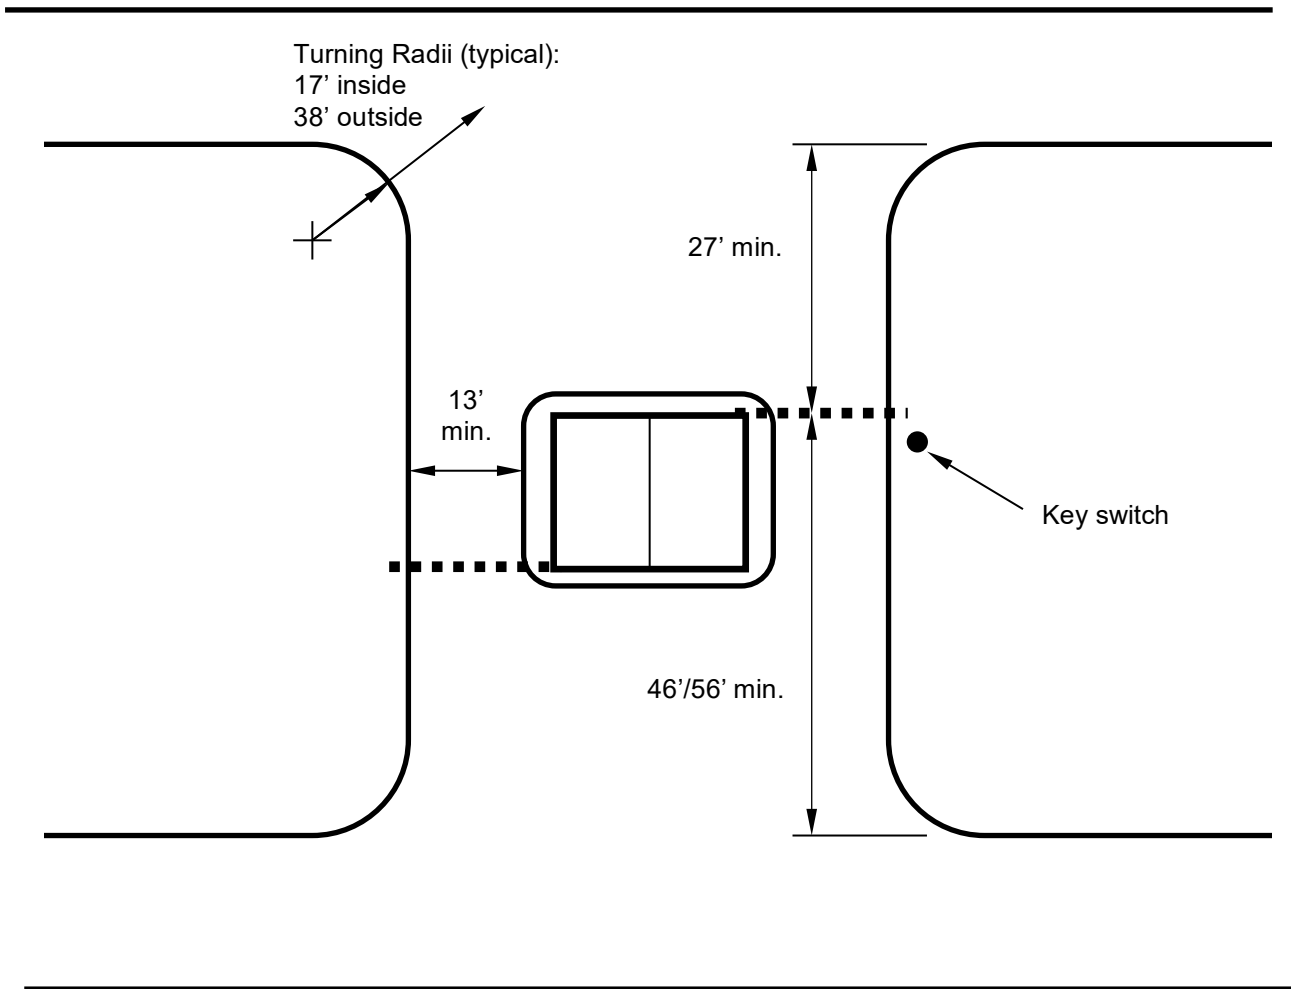

# ATTACHMENT 16

## Specifications for “Fire Lane - No Parking” Signs for Manually Operated Gates and Barriers

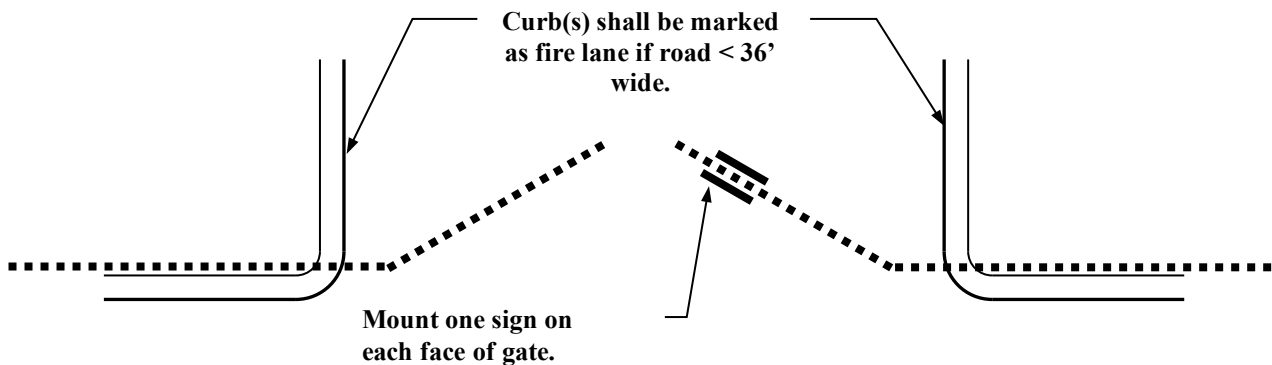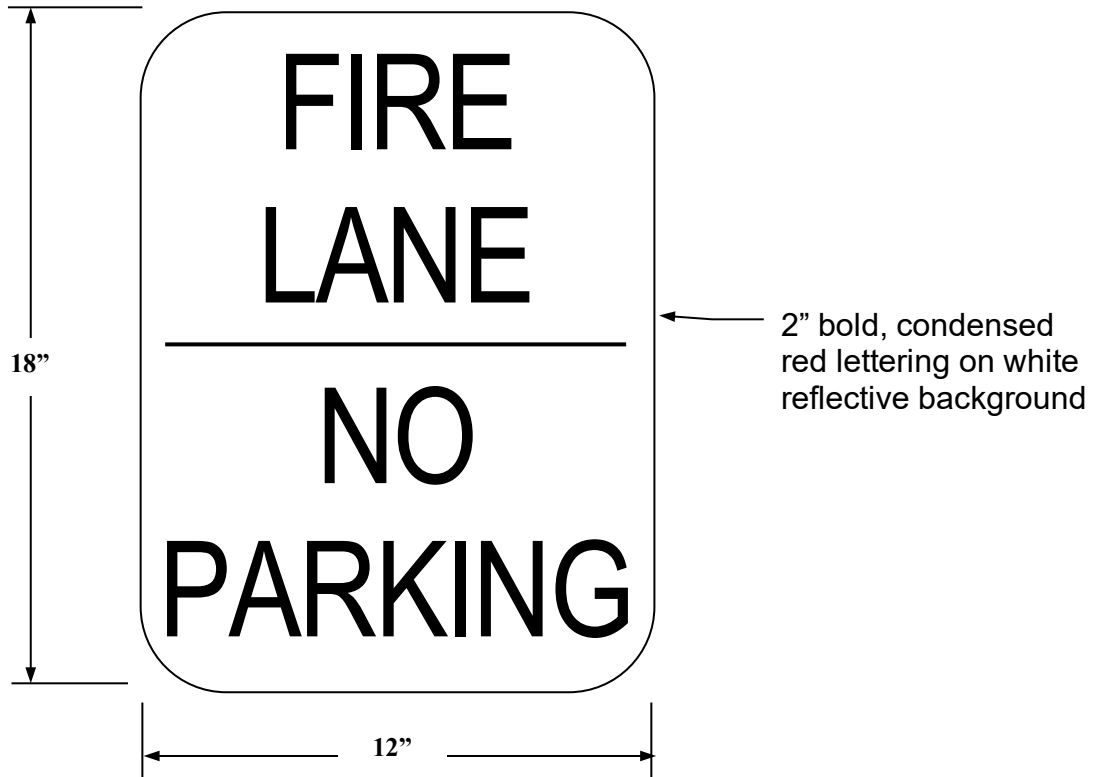


All sign and lettering dimensions shown are minimums. “Arial Narrow” font used is used in sample above though other legible sans-serif fonts may be acceptable.

“Fire Lane—No Parking” sign shown in Attachment 12 may be used as an alternative. Signs shall be securely mounted on the front and back face of the gate clearly visible to traffic entering the designated area. Signs shall be made of a durable material.


# ATTACHMENT 17

## Cul-de-sacs and Dead-end Roadways

- 1) Cul-de-sac streets greater than 150 feet in length that are required fire lanes shall be provided with a 38-foot minimum turning radius in the bulb.

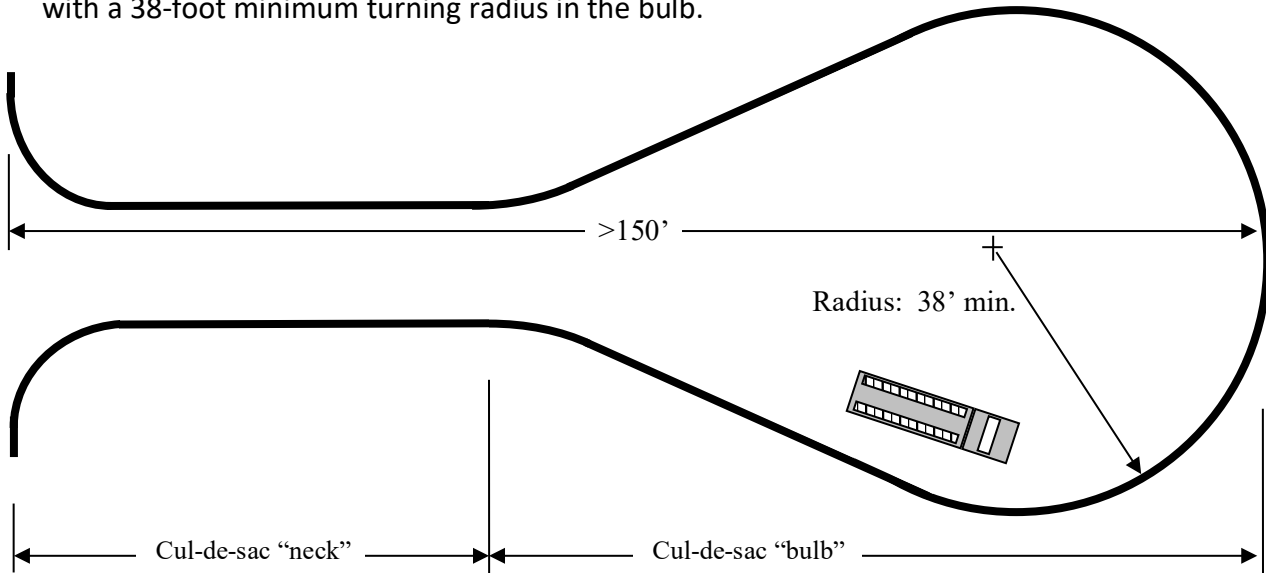

- 2) Where a spur road or private driveway that is a required fire lane is accessed via the cul-de-sac road, the driveway or spur shall be no more than 150' in length unless an approved turnaround has been provided within 150' of the end of the spur or driveway.

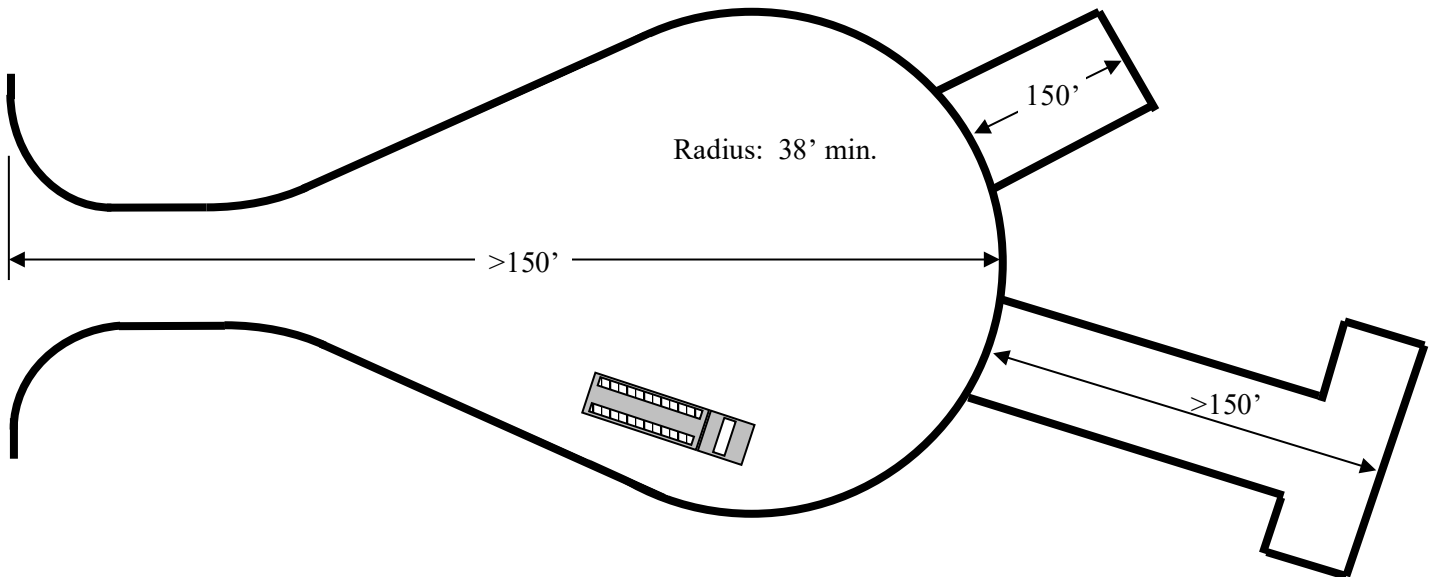


*Drawing  
not to scale*

# ATTACHMENT 18

## Cul-de-sacs Longer than 150' with Islands

Cul-de-sac streets greater than 150 feet in length may contain a center island provided that:

- 1) A *minimum* 28-foot-wide drive lane with an adequate inside turning radius is provided, and
- 2) The island is designated a no parking area with red curbs or signs, and
- 3) Island landscaping will not intrude into the drive lane, and
- 4) AN NFPA 13-D sprinkler system with full protection of the attic space(s) is installed in the homes where hose-pull requirements can only be satisfied by taking access from the drive lane beyond the beginning of the island.

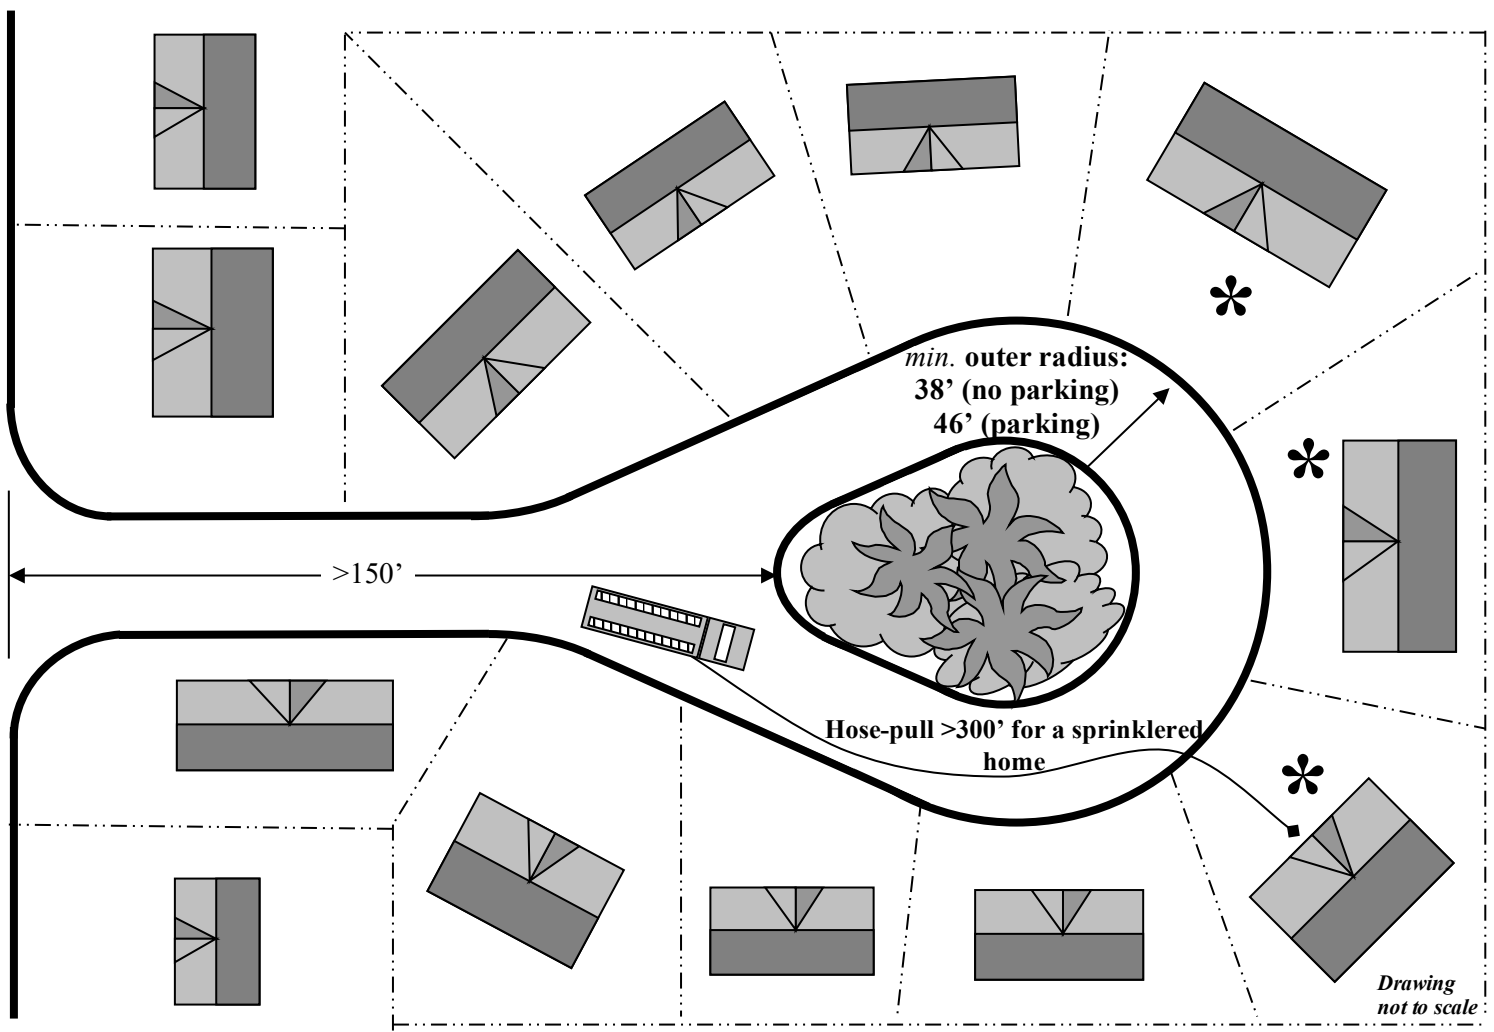


- \* Attic protection required where hose-pull distance from the portion of the cul-de-sac preceding the island to the front entry of a sprinklered home exceeds 300'. For existing unsprinklered homes, hose pull may not exceed 150' to the most remote point around the perimeter of the home or sprinklers with attic protection will be required.

# ATTACHMENT 19

## Cul-de-sacs up to 150' with Islands


Access to the homes will be measured along an approved route around the island and any other obstructions in the path of travel from the point where the island begins to impede fire apparatus. If hose-pull to the main entry of a sprinklered home exceeds 300' (or 150' to the most remote point around the perimeter for unsprinklered homes), the portion of the bulb beyond the island shall be designed as a fire lane or other mitigating features shall be provided. If all homes are in access from the area preceding the island, the portion of the bulb beyond the island is not required to comply with Carlsbad fire access roadway requirements. The neck and portion of the bulb preceding the island shall meet all other fire lane requirements prescribed in this guideline if it is a required fire lane.

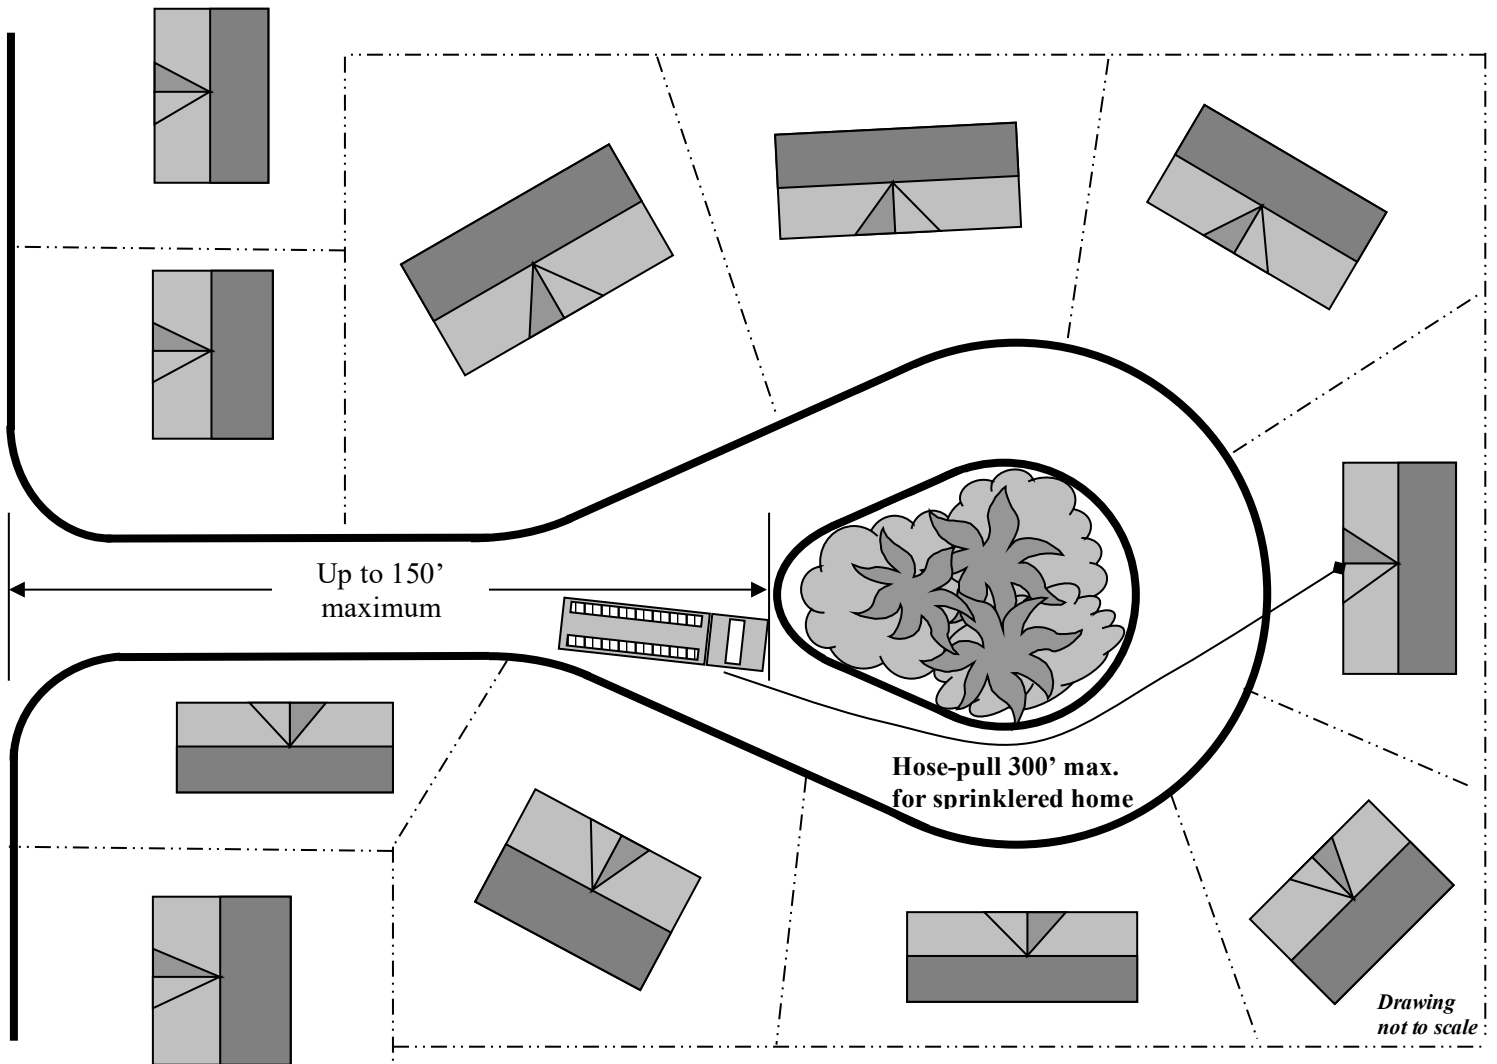

# ATTACHMENT 20

## Short Cul-de-sacs and Dead-end Roads

If hose-pull distance can be satisfied without fire apparatus entering the cul-de-sac or dead-end road, and the road is not otherwise required to be a fire lane as determined by the fire code official, the street is not required to have a bulb or hammerhead with minimum Carlsbad turning radii or meet other standard fire lane requirements.

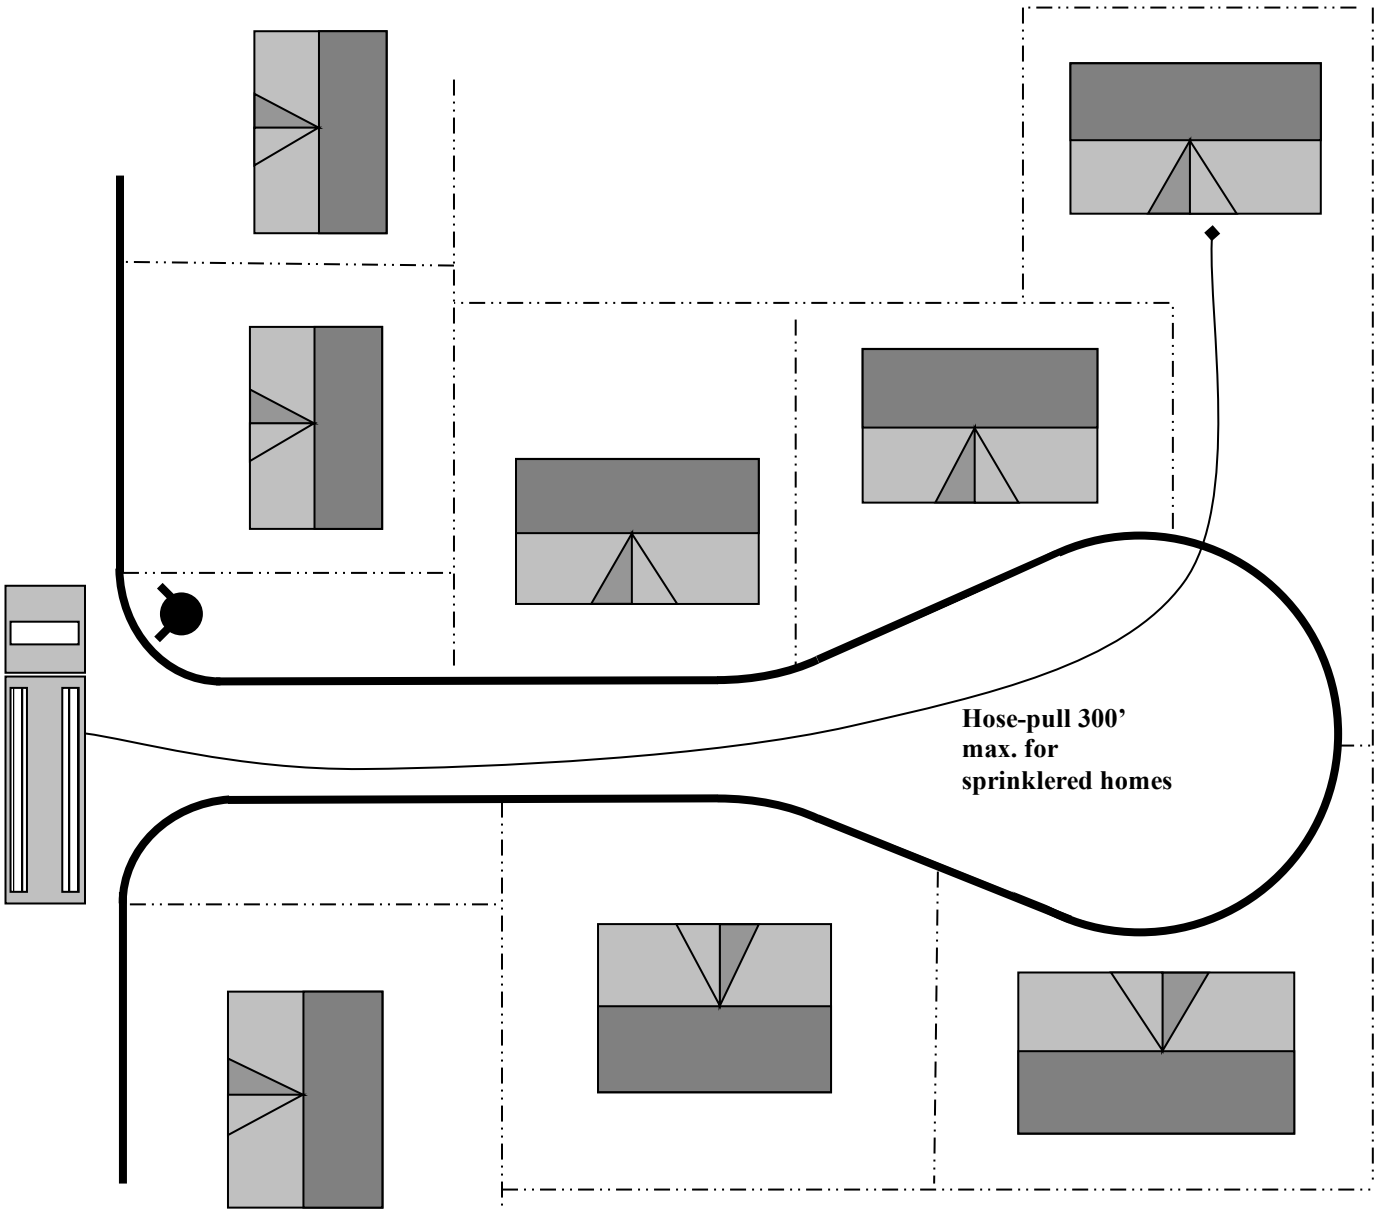




# ATTACHMENT 21

## Eyebrows

If the eyebrow does not meet Carlsbad's minimum turning radius and width requirements, fire department access will be measured from the nearest available fire lane around the island and any other obstructions. If hose-pull to the main entry of a sprinklered home exceeds 300' (or 150' to the most remote point around the perimeter for unsprinklered homes), the eyebrow shall be designed as a fire lane or other mitigating features shall be provided.

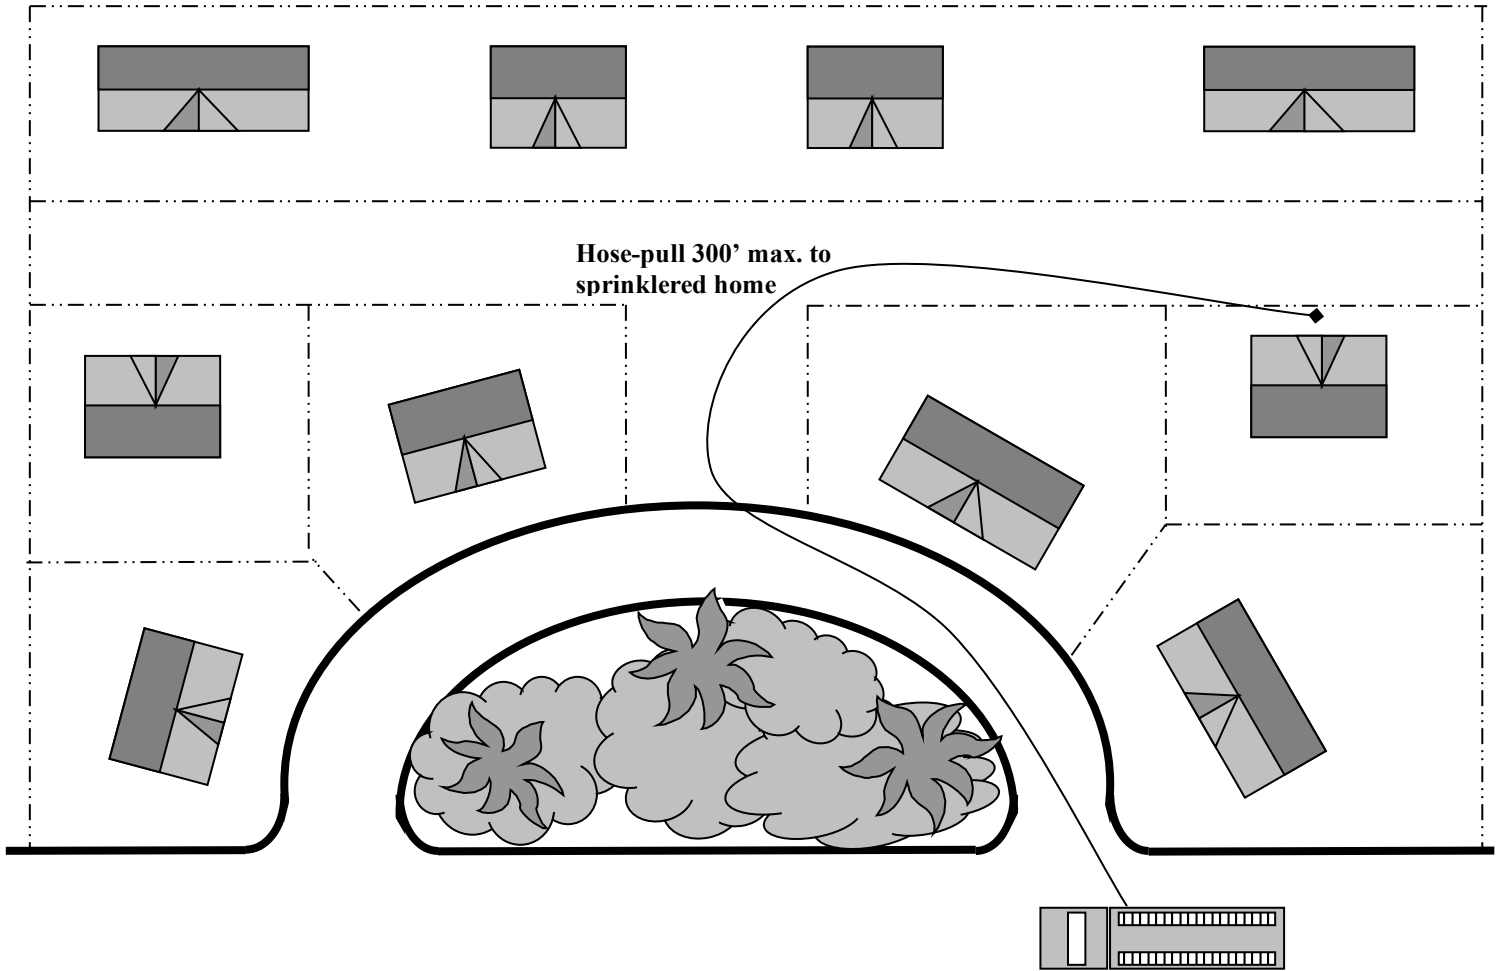

*Drawing  
not to scale*

# ATTACHMENT 22

## Sample Parking Enforcement Letter

Date

City of Carlsbad  
1635 Faraday Ave.  
Carlsbad, CA. 92008

Re:    (*Project Name, Location, and Permit Number*)  
      Parking Enforcement Plan

The fire lane parking enforcement plan for the above referenced project is stated as follows:

All fire lanes within (*list development address or tract information*) shall be maintained and in no event shall parking be permitted along any portion of a street or drive that required fire lanes or any area designated as a fire lane for turn-around purposes either during construction or after occupancy.

(*Association name*) shall adopt reasonable rules and regulations regarding the parking of vehicles along the streets, roads and or drives within the project that are not in conflict with applicable law.

In furtherance thereof, (*Association name*), through its officers, committees and agents, will establish the “parking” and “no parking” areas within the property in accordance with Section 22658.2 of the California Vehicle Code and Carlsbad Fire Department Access & Water Guideline. The law shall be enforced through such rules and regulations by all lawful means, including, written warnings, citing, levying fines and towing vehicles in violation.

(*Association name*) will contract with a certified patrol and towing company to remove vehicles that violate no parking restrictions. First time violators will receive a written warning and with subsequent violations, the vehicle shall be subject to towing. The vehicle owner shall be responsible for all costs incurred in remedying such violation, including without limitation towing cost, citations and legal fees.

Company Name  
Authorized Agent Signature  
Cc:

# ATTACHMENT 23

## REQUIRED FIRE FLOW FOR ONE- AND TWO-FAMILY DWELLINGS, GROUP R-3 AND R-4 BUILDINGS AND TOWNHOUSES

**TABLE B105.1(1)**

FIRE-FLOW CALCULATION AREA (square feet)	AUTOMATIC SPRINKLER SYSTEM (Design Standard)	MINIMUM FIRE FLOW (gallons per minute)	FLOW DURATION (hours)
0—3,600	No automatic sprinkler system	1,000	1
3,601 and greater	No automatic sprinkler system	Value in Table B105.1(2)	Duration in Table B105.1(2) at the required fire-flow rate
0—3,600	<u>Section 903.3.1.3</u> of the <i>California Fire Code</i> or <u>Section 313.3</u> of the <i>California Residential Code</i>	500*	½
3,601 and greater	<u>Section 903.3.1.3</u> of the <i>California Fire Code</i> or <u>Section 313.3</u> of the <i>California Residential Code</i>	1/2 value in Table B105.1(2)	1

For SI: 1 square foot = 0.0929 m<sup>2</sup>, 1 gallon per minute = 3.785 L/m.

Fire flow measured at 20 psi

\* Minimum fire flow for a single-family residence/duplex up to 3600 sq.ft. is 1000 gpm.

# ATTACHMENT 24

**TABLE B105.2  
REQUIRED FIRE FLOW FOR BUILDINGS OTHER THAN ONE- AND TWO-  
FAMILY DWELLINGS, GROUP R-3 AND R-4 BUILDINGS  
AND TOWNHOUSES PER CARLSBAD MUNICIPAL CODE**

AUTOMATIC SPRINKLER SYSTEM (Design Standard)	MINIMUM FIRE-FLOW (gallons per minute)	FLOW DURATION (hours)
No automatic sprinkler system	Value in Table B105.1(2)	Duration in Table B105.1(2)
Section 903.3.1.1 of the <i>California Fire Code</i>	50% of the value in Table B105.1(2) <sup>a</sup>	Duration in Table B105.1(2) at the reduced flow rate
Section 903.3.1.2 of the <i>California Fire Code</i>	50% of the value in Table B105.1(2) <sup>b</sup>	Duration in Table B105.1(2) at the reduced flow rate

For SI: 1 square foot = 0.0929 m<sup>2</sup>, 1 gallon per minute = 3.785 L/m.

- a) The reduced fire-flow shall be not less than 1,000 gallons per minute
- b) The reduced fire-flow shall not be less than 1,500 gallons per minute

# ATTACHMENT 25

## CFC TABLE B105.1(2) Minimum Required Fire Flow and Flow Duration for Buildings

### REFERENCE TABLE FOR TABLES B105.1(1) AND B105.2

FIRE-FLOW CALCULATION AREA (square feet)					FIRE FLOW (gallons per minute) <sup>b</sup>	FLOW DURATION (hours)
Type IA and IB <sup>a</sup>	Type IIA and IIIA <sup>a</sup>	Type IV and V-A <sup>a</sup>	Type IIB and IIIB <sup>a</sup>	Type V-B <sup>a</sup>		
0–22,700	0–12,700	0–8,200	0–5,900	0–3,600	1,500	2
22,701–30,200	12,701–17,000	8,201–10,900	5,901–7,900	3,601–4,800	1,750	
30,201–38,700	17,001–21,800	10,901–12,900	7,901–9,800	4,801–6,200	2,000	
38,701–48,300	21,801–24,200	12,901–17,400	9,801–12,600	6,201–7,700	2,250	
48,301–59,000	24,201–33,200	17,401–21,300	12,601–15,400	7,701–9,400	2,500	
59,001–70,900	33,201–39,700	21,301–25,500	15,401–18,400	9,401–11,300	2,750	
70,901–83,700	39,701–47,100	25,501–30,100	18,401–21,800	11,301–13,400	3,000	3
83,701–97,700	47,101–54,900	30,101–35,200	21,801–25,900	13,401–15,600	3,250	
97,701–112,700	54,901–63,400	35,201–40,600	25,901–29,300	15,601–18,000	3,500	
112,701–128,700	63,401–72,400	40,601–46,400	29,301–33,500	18,001–20,600	3,750	
128,701–145,900	72,401–82,100	46,401–52,500	33,501–37,900	20,601–23,300	4,000	4
145,901–164,200	82,101–92,400	52,501–59,100	37,901–42,700	23,301–26,300	4,250	
164,201–183,400	92,401–103,100	59,101–66,000	42,701–47,700	26,301–29,300	4,500	

183,401– 203,700	103,101– 114,600	66,001– 73,300	47,701– 53,000	29,301– 32,600	4,750
203,701– 225,200	114,601– 126,700	73,301– 81,100	53,001– 58,600	32,601– 36,000	5,000
225,201– 247,700	126,701– 139,400	81,101– 89,200	58,601– 65,400	36,001– 39,600	5,250
247,701– 271,200	139,401– 152,600	89,201– 97,700	65,401– 70,600	39,601– 43,400	5,500
271,201– 295,900	152,601– 166,500	97,701– 106,500	70,601– 77,000	43,401– 47,400	5,750
295,901– Greater	166,501– Greater	106,501– 115,800	77,001– 83,700	47,401– 51,500	6,000
—	—	115,801– 125,500	83,701– 90,600	51,501– 55,700	6,250
—	—	125,501– 135,500	90,601– 97,900	55,701– 60,200	6,500
—	—	135,501– 145,800	97,901– 106,800	60,201– 64,800	6,750
—	—	145,801– 156,700	106,801– 113,200	64,801– 69,600	7,000
—	—	156,701– 167,900	113,201– 121,300	69,601– 74,600	7,250
—	—	167,901– 179,400	121,301– 129,600	74,601– 79,800	7,500
—	—	179,401– 191,400	129,601– 138,300	79,801– 85,100	7,750
—	—	191,401– Greater	138,301– Greater	85,101– Greater	8,000

For SI: 1 square foot = 0.0929 m<sup>2</sup>, 1 gallon per minute = 3.785 L/m, 1 pound per square inch = 6.895 kPa.

- a) Types of construction are based on the International Building Code.
- b) Measured at 20 psi residual pressure.

# ATTACHMENT 26

## CFC TABLE C102.1: Hydrant Quantity and Spacing as adopted by the City of Carlsbad

FLOW REQUIREMENT from Table B105.1	Minimum # of Hydrants	Average Hydrant Spacing (feet) <sup>1, 2, 3</sup>	Maximum Distance to Hydrant (feet) <sup>4, 6</sup>
up to 1750	1	500	250
1751-2250	2	450	225
2251-2750	3	450	225
2751-3250	3	400	225
3251-4000	4	350	210
4001-5000	5	300	180
5001-5500	6	300	180
5501-6000	6	250	150
6001-7000	7	250	150
7001+	8 or more <sup>5</sup>	200	120

<sup>1</sup> Reduce by 100 feet for dead-end streets or roads.

<sup>2</sup> Where streets are provided with median dividers which can be crossed by fire fighters pulling hose lines, or where arterials streets are provided with four or more traffic lanes and have a traffic count of more than 30,000 vehicles per day, hydrant spacing shall average 500 feet on each side of the street and be arranged on an alternating basis up to a fire-flow requirement of 7,000 gallons per minute and 400 feet for higher fire-flow requirements.

<sup>3</sup> Where new water mains are extended along streets where hydrants are not needed for protection of structures or similar fire problems, fire hydrants shall be provided at spacing not to exceed 1,000 feet to provide for transportation hazards.


<sup>4</sup> Reduce by 50 feet for dead-end streets or roads.

<sup>5</sup> One hydrant for each 1,000 gallons per minute or fraction thereof.

<sup>6</sup> Distance to a hydrant within a single-family residential tract shall not exceed 300; it may be up to 600 feet if the homes are protected by an NFPA 13-D sprinkler system and a fire flow of 2000 gpm is provided.

# ATTACHMENT 27

## Protection of Hydrants, Detector Checks, Fire Department Connections, and other Appurtenances

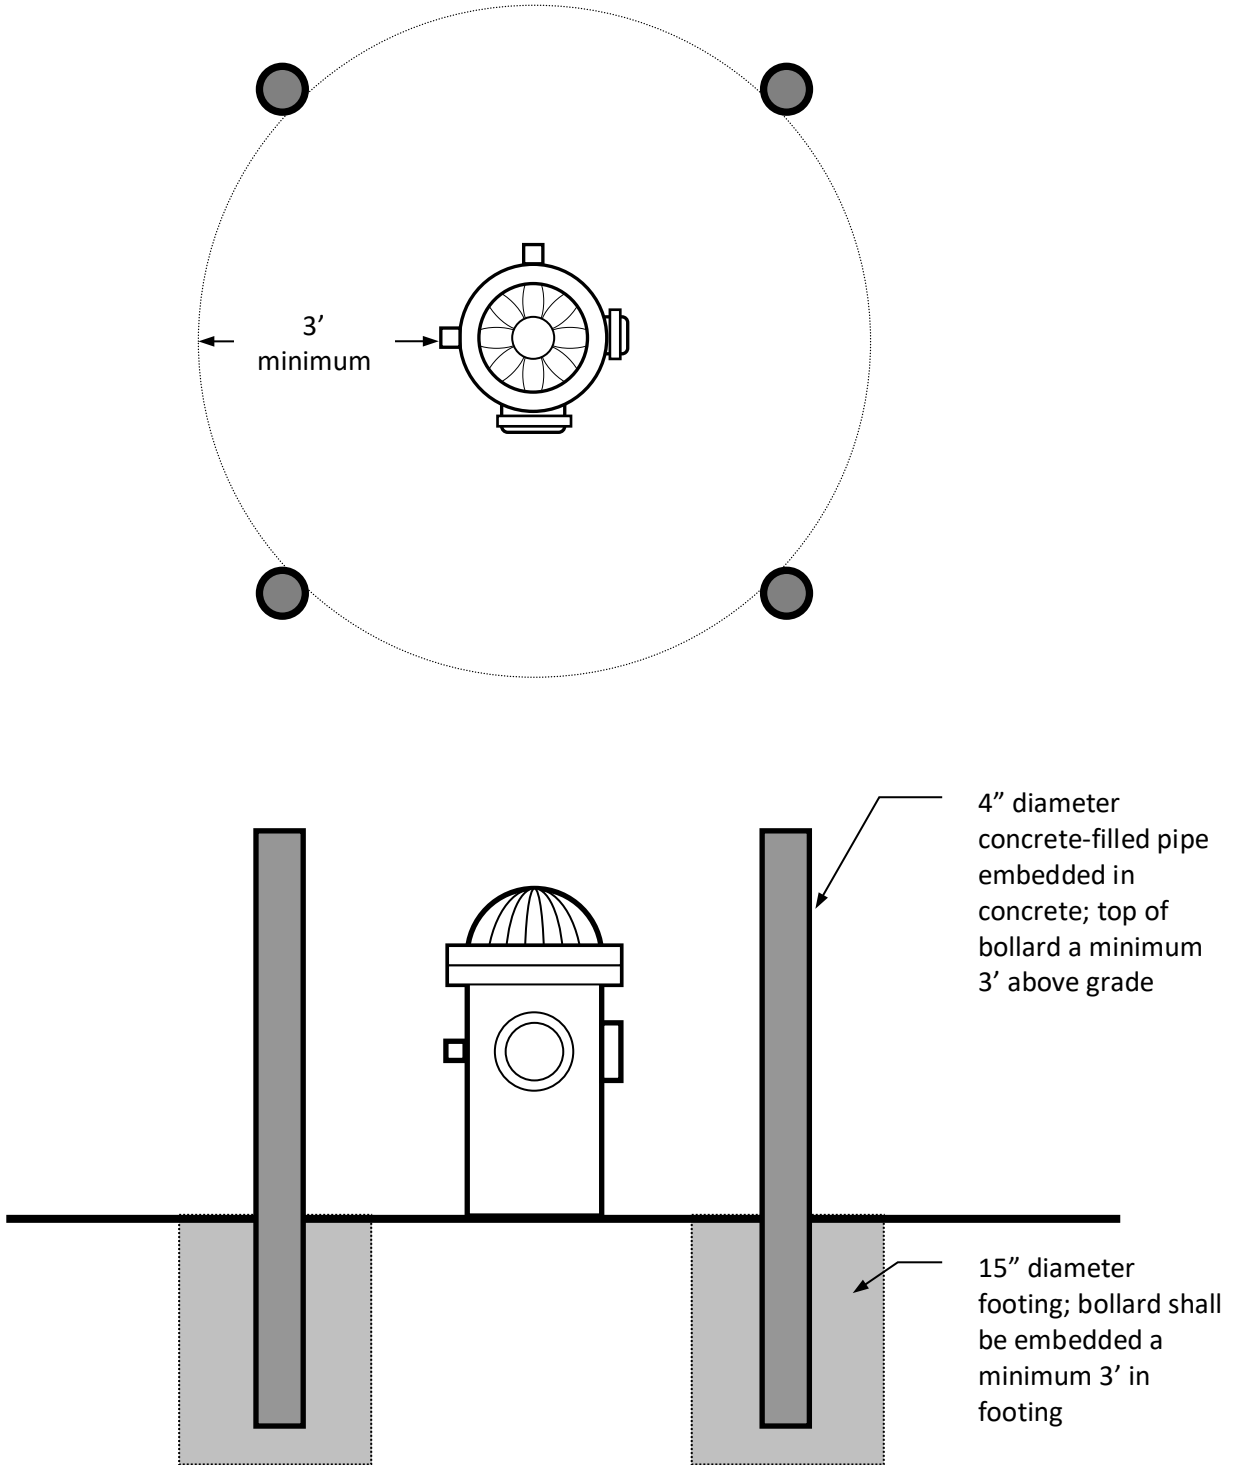





# ATTACHMENT 28

## Blue Dot Hydrant Marker Location


TWO LANE STREET




MULTI-LANE STREET

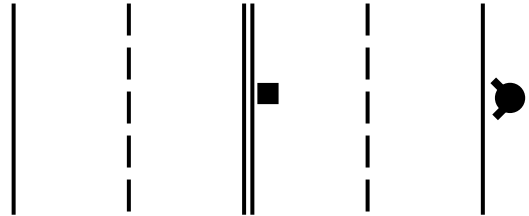


INTERSECTION

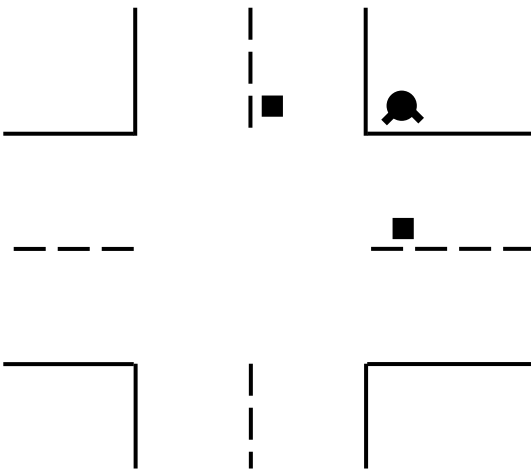


INTERSECTION WITH TURN LANES

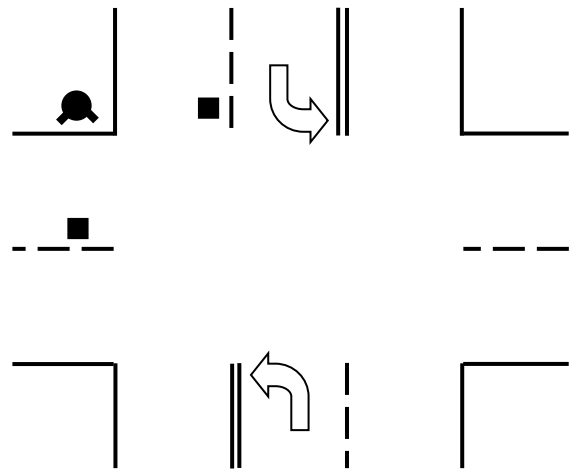

MULTILANE STREET WITH TURN LANE

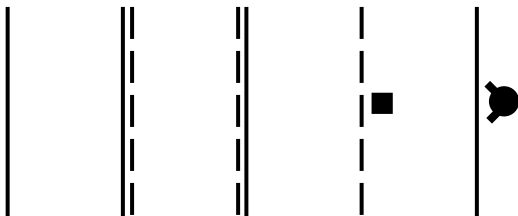


FREEWAYS AND EXPRESSWAYS

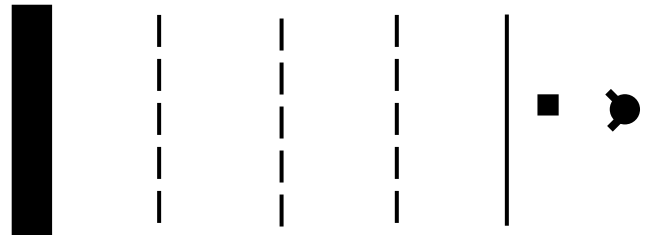

The developer may contact the local water company to arrange the installation of the blue dots. If the water agency does not participate in the blue dot program, the developer is still responsible to install the dots in an approved manner.

# ATTACHMENT 29

## Hose Pull

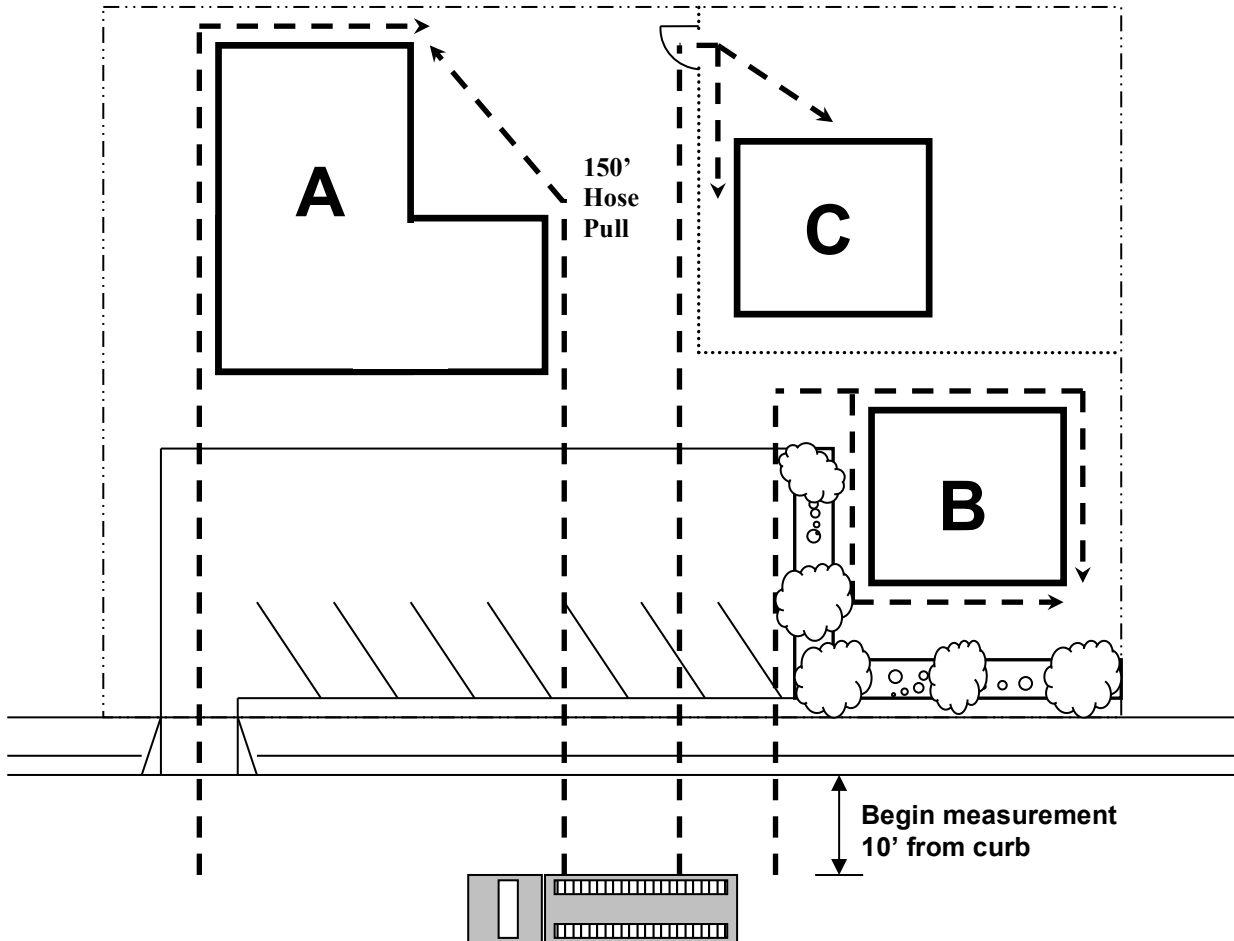

In the example above, assume that the parking lot is not accessible to fire apparatus due to turning radii and fire lane widths less than the required minimums.

- A. All portions of building “A” are within 150’ feet of the public road as measured along the path of firefighter travel. This building is in access.
- B. Building “B” is also in access despite the obstruction presented by the planter and hedges.
- C. Building “C” is out of access; the presence of a chain-link fence forces firefighters to backtrack once they pass through the gate, increasing their travel distance beyond 150’. On-site fire access roadways or a change in the location of the gate and would be necessary to provide access to Building “C”.

# ATTACHMENT 30

## Hose Pull vs. Hose Lay

**A: Hose Pull (Distance from Engine to Building):** Represents the amount of fire hose that firefighters must pull from the engine to reach the structure. Hose pull may not exceed 150'. In the diagram below, firefighters would be able to reach the entire perimeter of the building by pulling no more than 150' of hose from one or more fire engines staged in the shaded portion of the fire lane. For hydrant evaluation purposes, this part of the fire lane is considered to serve the building and must meet hose lay requirements. See Attachment 29 for further information on hose pull measurement and access to structures.

**B: Hose Lay (Distance from Engine to a Hydrant):** Represents the amount of supply hose that must be laid out of the back of the engine to bring water from the hydrant to the engine. No point along the portion of the fire lane serving the structure (the shaded road) may be farther from a hydrant than the distance specified under "Maximum Distance" in CFC Table C102.1 (see Attachment 26). The hydrant may be located along portions of the fire lane that exceed the hose pull distance provided that it is 1) on the same property, 2) on an adjacent property where an emergency access easement has been obtained, or 3) on a public road leading to the fire lane serving the property. Hose lay is measured along the vehicle path of travel in the fire lane, not "as the crow flies."

**C: Hydrant Spacing (Distance between Hydrants)**—the distance between hydrants serving the building shall not exceed twice the "Maximum Distance" listed in CFC Table C102.1, as measured along the fire lane. Hydrants located on portions of the fire lane that do not serve the building do not need to be evaluated for spacing relative to each other, only with respect to hydrants that do serve the structure. For example, when evaluating hydrant placement for the building shown in the diagram below,  $C_1$  may exceed the hydrant spacing requirements, while  $C_2$  and  $C_3$  cannot. The "Average Spacing" from Table C102.1 shall be maintained to prevent multiple hydrants from being concentrated in only one portion of the fire lane.

